



Model 682C03

ICP® VIBRATION TRANSMITTER

Installation and Operating Manual

**For assistance with the operation of this product,
contact the PCB Piezotronics, Inc.**

Toll-free: 800-959-4464

24-hour SensorLine: 716-684-0001

Fax: 716-684-3823

E-mail: imi@pcb.com

Web: www.imi-sensors.com





Service, Repair, and Return Policies and Instructions
--

The information contained in this document supersedes all similar information that may be found elsewhere in this manual.

Service – Due to the sophisticated nature of the sensors and associated instrumentation provided by PCB Piezotronics, user servicing or repair is not recommended and, if attempted, may void the factory warranty. Routine maintenance, such as the cleaning of electrical connectors, housings, and mounting surfaces with solutions and techniques that will not harm the physical material of construction, is acceptable. Caution should be observed to ensure that liquids are not permitted to migrate into devices that are not hermetically sealed. Such devices should only be wiped with a dampened cloth and never submerged or have liquids poured upon them.

Repair – In the event that equipment becomes damaged or ceases to operate, arrangements should be made to return the equipment to PCB Piezotronics for repair. User servicing or repair is not recommended and, if attempted, may void the factory warranty.

Calibration – Routine calibration of sensors and associated instrumentation is recommended as this helps build confidence in measurement accuracy and acquired data. Equipment calibration cycles are typically established by the users own quality regimen. When in doubt about a calibration cycle, a good “rule of thumb” is to recalibrate on an annual basis. It is

also good practice to recalibrate after exposure to any severe temperature extreme, shock, load, or other environmental influence, or prior to any critical test.

PCB Piezotronics maintains an ISO-9001 certified metrology laboratory and offers calibration services, which are accredited by A2LA to ISO/IEC 17025, with full traceability to SI through N.I.S.T. In addition to the normally supplied calibration, special testing is also available, such as: sensitivity at elevated or cryogenic temperatures, phase response, extended high or low frequency response, extended range, leak testing, hydrostatic pressure testing, and others. For information on standard recalibration services or special testing, contact your local PCB Piezotronics distributor, sales representative, or factory customer service representative.

Returning Equipment – *Following these procedures will ensure that your returned materials are handled in the most expedient manner.* Before returning any equipment to PCB Piezotronics, contact your local distributor, sales representative, or factory customer service representative to obtain a Return **Warranty, Service, Repair, and Return Policies and Instructions** Materials Authorization (RMA) Number. This RMA number should be clearly marked on the outside of all package(s) and on the packing

list(s) accompanying the shipment. A detailed account of the nature of the problem(s) being experienced with the equipment should also be included inside the package(s) containing any returned materials.

A Purchase Order, included with the returned materials, will expedite the turn-around of serviced equipment. It is recommended to include authorization on the Purchase Order for PCB to proceed with any repairs, as long as they do not exceed 50% of the replacement cost of the returned item(s). PCB will provide a price quotation or replacement recommendation for any item whose repair costs would exceed 50% of replacement cost, or any item that is not economically feasible to repair. For routine calibration services, the Purchase Order should include authorization to proceed and return at current pricing, which can be obtained from a factory customer service representative.

Contact Information – International customers should direct all inquiries to their local distributor or sales office. A

complete list of distributors and offices can be found at www.pcb.com. Customers within the United States may contact their local sales representative or a factory customer service representative. A complete list of sales representatives can be found at www.pcb.com. Toll-free telephone numbers for a factory customer service representative, in the division responsible for this product, can be found on the title page at the front of this manual. Our ship to address and general contact numbers are:

PCB Piezotronics, Inc.
3425 Walden Ave.
Depew, NY14043 USA
Toll-free: (800) 828-8840
24-hour SensorLineSM: (716) 684-0001
Website: www.pcb.com
E-mail: info@pcb.com



PCB工业监视和测量设备 - 中国RoHS2公布表
PCB Industrial Monitoring and Measuring Equipment - China RoHS 2 Disclosure Table

部件名称	有害物质					
	铅 (Pb)	汞 (Hg)	镉 (Cd)	六价铬 (Cr(VI))	多溴联苯 (PBB)	多溴二苯醚 (PBDE)
住房	O	O	O	O	O	O
PCB板	X	O	O	O	O	O
电气连接器	O	O	O	O	O	O
压电晶体	X	O	O	O	O	O
环氧	O	O	O	O	O	O
铁氟龙	O	O	O	O	O	O
电子	O	O	O	O	O	O
厚膜基板	O	O	X	O	O	O
电线	O	O	O	O	O	O
电缆	X	O	O	O	O	O
塑料	O	O	O	O	O	O
焊接	X	O	O	O	O	O
铜合金/黄铜	X	O	O	O	O	O
本表格依据 SJ/T 11364 的规定编制。						
O：表示该有害物质在该部件所有均质材料中的含量均在 GB/T 26572 规定的限量要求以下。						
X：表示该有害物质至少在该部件的某一均质材料中的含量超出 GB/T 26572 规定的限量要求。						
铅是欧洲RoHS指令2011/65/ EU附件三和附件四目前由于允许的豁免。						

CHINA RoHS COMPLIANCE

Component Name	Hazardous Substances					
	Lead (Pb)	Mercury (Hg)	Cadmium (Cd)	Chromium VI Compounds (Cr(VI))	Polybrominated Biphenyls (PBB)	Polybrominated Diphenyl Ethers (PBDE)
Housing	O	O	O	O	O	O
PCB Board	X	O	O	O	O	O
Electrical Connectors	O	O	O	O	O	O
Piezoelectric Crystals	X	O	O	O	O	O
Epoxy	O	O	O	O	O	O
Teflon	O	O	O	O	O	O
Electronics	O	O	O	O	O	O
Thick Film Substrate	O	O	X	O	O	O
Wires	O	O	O	O	O	O
Cables	X	O	O	O	O	O
Plastic	O	O	O	O	O	O
Solder	X	O	O	O	O	O
Copper Alloy/Brass	X	O	O	O	O	O

This table is prepared in accordance with the provisions of SJ/T 11364.

O: Indicates that said hazardous substance contained in all of the homogeneous materials for this part is below the limit requirement of GB/T 26572.

X: Indicates that said hazardous substance contained in at least one of the homogeneous materials for this part is above the limit requirement of GB/T 26572.

Lead is present due to allowed exemption in Annex III or Annex IV of the European RoHS Directive 2011/65/EU.

DOCUMENT NUMBER: 21354

DOCUMENT REVISION: **D**

ECN: 46162

682 Series 4-20mA Din Rail ICP[®] Signal Conditioner

CE



Operating Guide with Enclosed Warranty Information

3425 Walden Avenue, Depew, New York 14043-2495

Phone (716) 684-0003

Fax (716) 684-3823

Toll Free Line 1-800-959-4IMI

MANUAL NUMBER: 60419
MANUAL REVISION: **B**
ECN NUMBER: **46422**

Table of Contents

<i>Introduction.....</i>	<i>Page 3</i>
Block diagram.....	<i>Page 3</i>
<i>General Features.....</i>	<i>Page 4</i>
<i>Installation and Wiring</i>	<i>Page 5</i>
<i>Configuring the 682BX3</i>	<i>Page 9</i>
<i>ESD Sensitivity.....</i>	<i>Page 12</i>
<i>Ordering Information</i>	<i>Page 13</i>


Warranty/Service

<i>Warranty, Service & Return Procedure</i>	<i>Page 14</i>
<i>Customer Service</i>	<i>Page 15</i>

Introduction

The 682 Series is a 4-20mA Din Rail Signal Conditioner designed to interface with IMI Sensor's ICP® Accelerometer. Acceleration, Velocity, or Displacement can be converted to a 4-20mA signal by simple DIP Switch selection internal to the Din Rail enclosure. An additional standard feature of the 682 Series is the ability to convert the temperature output from an accelerometer (when equipped) to 4-20mA. Signal Filtering can be easily configured in the field by installing factory calibrated Filter Modules into sockets located inside the enclosure.

Block Diagram

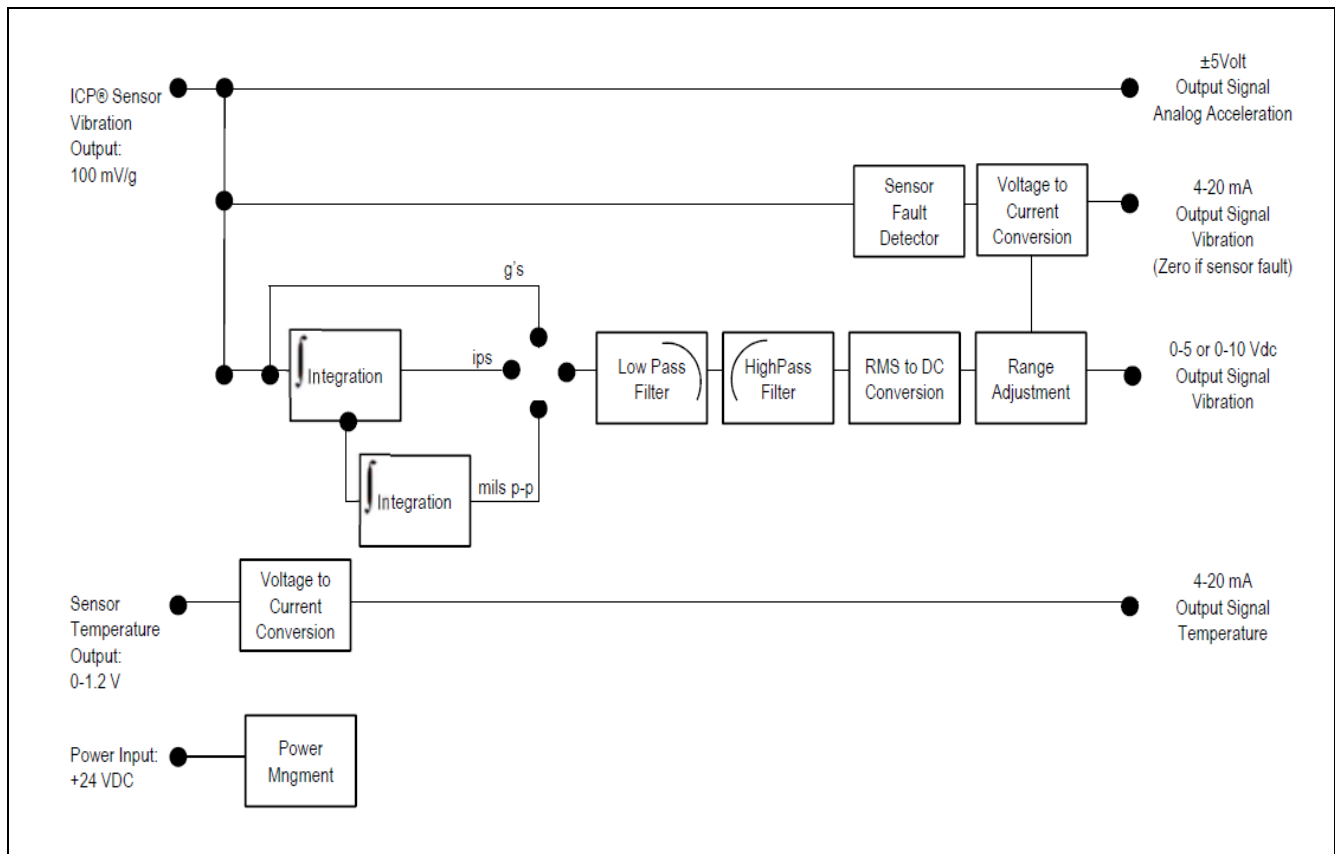

General Features

- External transmitters, signal conditioners, and ICP® power supplies can be eliminated by direct connection of the sensor to the Din Rail Signal Conditioner.
- Optional 500Vdc Input to Output Electrical Isolation.
- Selectable 24Vdc Unregulated, 18Vdc regulated, 4mA excitation to power sensor
- 4-20mA Output Signals for Vibration and Temperature.
- Selectable 0-5 or 0-10Vdc Output Signal for Vibration.
- Internal DIP switch selectable vibration ranges include:


Acceleration (g's)	Velocity (in/sec)	Displacement (mils p-p)
5.00	0.50	10.0
10.00	1.00	20.0
20.00	2.00	40.0

- Internal DIP switch selection for Peak or RMS.
- Utilization of Filter Modules for field configuration of High and Low pass 2-pole filtering.
- Analog output signal connections (RV) for conducting frequency analysis and machinery diagnostics.
- LED indicators for Power, Sensor Fault, Acceleration, Velocity, and Displacement.
- Electronic Sensor Fault Indication via 4-20mA output by providing a 0mA signal.
- Configurable for ICP® Sensor Power disable to accommodate existing applications.
- Removable Terminal Blocks for easy wiring.
- 35mm (1.38in.) Din Rail Mount configuration.
- Space saving 22.5mm (0.9in.) wide design.

Installation and Wiring

Installation

The 682 Series is designed to be mounted on a 35mm Din Rail. Do not install in a harsh area where it can be exposed to cleaning fluids or machine oils. IMI Sensors recommends mounting the 682BX3 in a type NEMA 4 enclosure to protect the electronics from contamination.

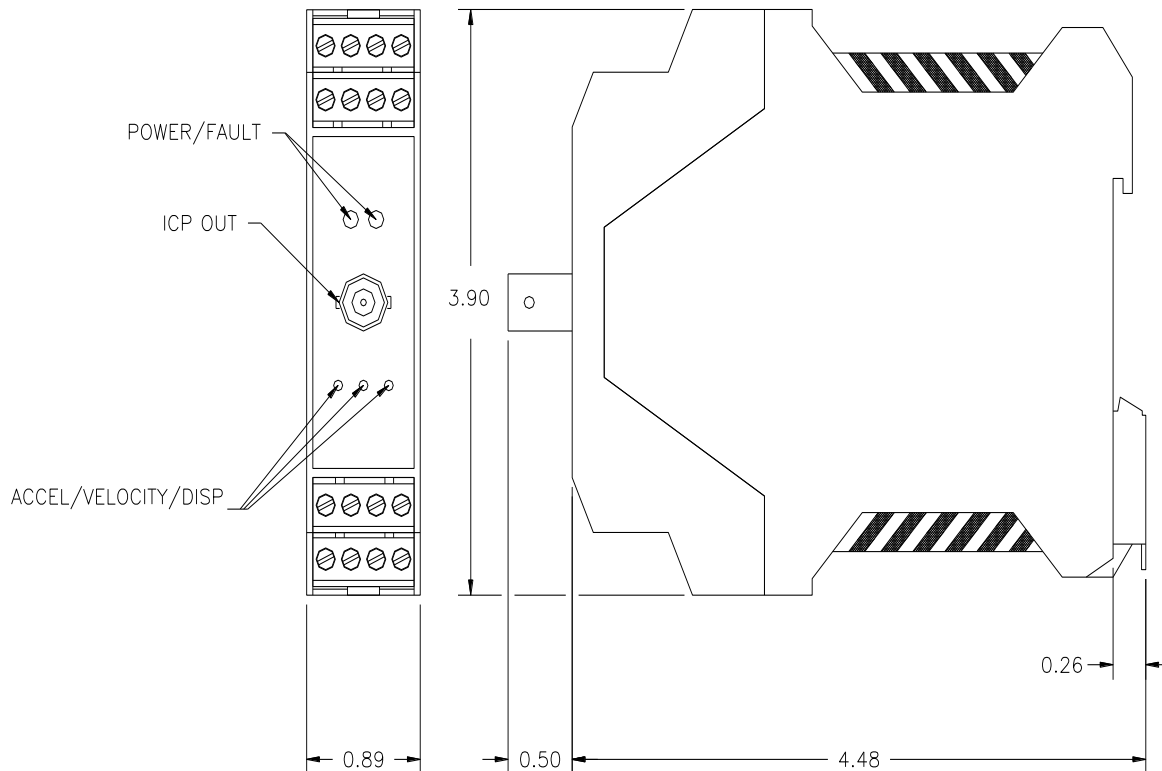

Dimension Drawing


The Power LED is Green which turns on when the unit is powered. The Fault LED is red which turns on when the sensor input is either open or shorted. The Acceleration, Velocity, and Displacement LED is Green which turns on when the corresponding dip switches shown on page 8 are set.

Connector and Pinout Diagram

The 682 Series uses plug-in type screw terminal connectors for all input and output connections.

Strip off 8mm of insulation from the connection wire ends. Using a screwdriver, remove the terminal block from the enclosure in either the up or down direction, terminate the wire in the correct location. Do not exceed a torque of 0.5Nm. Re-install the terminal block.

This easy to assemble connection method allows devices to be exchanged easily and the electrical connection to be visibly isolated.

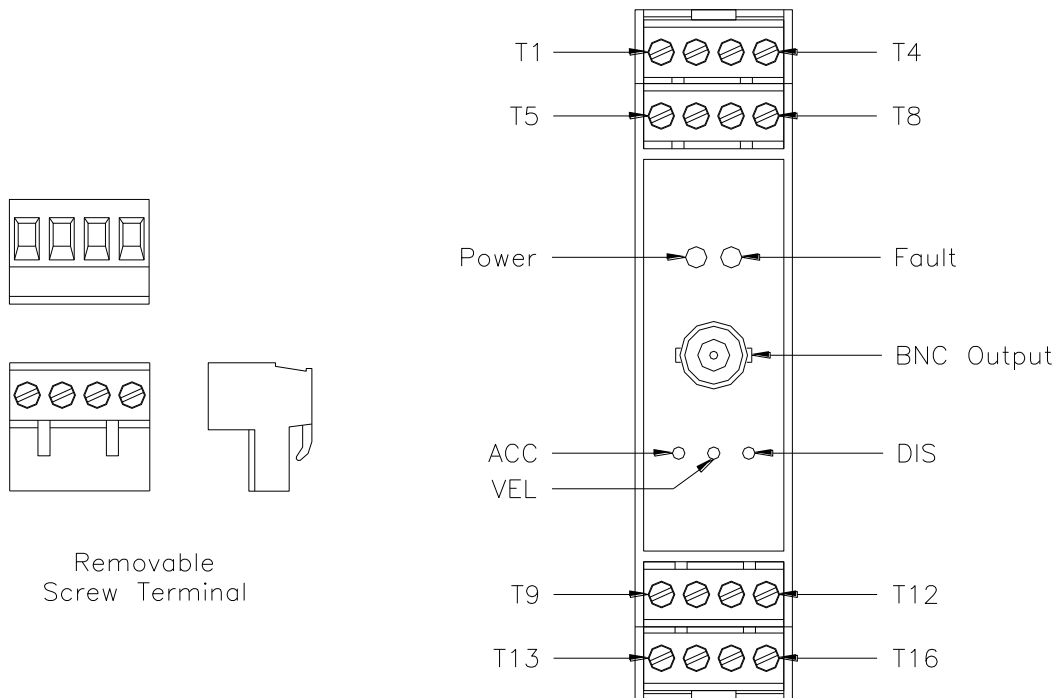

Pin Location Diagram



WARNING

AC and DC input signals and power supply voltages could be hazardous. DO NOT connect live wires to screw terminal plugs, and DO NOT insert, remove, or handle screw terminal plugs with live wires connected.

Pin Descriptions:

DC Power – Pins 1 to 3:

- Pin 1** +Power
- Pin 2** -Power/Common
- Pin 3** Earth Ground

ICP[®] Accelerometer – Pins 4 to 6:

- Pin 4** Shield
- Pin 5** + ICP[®] Accelerometer
- Pin 6** - ICP[®] Accelerometer

Temperature Sensor – Pins 7 to 8:

- Pin 7** + Temperature Sensor
- Pin 8** - Temperature Sensor (- ICP[®] Accelerometer)

Raw Vibration (RV) – Pins 9 to 10, and BNC Jack:

- Pin 9** + RV
- Pin 10** - RV

4 to 20mA Temperature Output – Pins 11 to 12:

- Pin 11** + 4 to 20mA Temperature Output
- Pin 12** - 4 to 20mA Temperature Output

4 to 20mA Vibration Output – Pins 13 to 14:

- Pin 13** + 4 to 20mA Vibration Output
- Pin 14** - 4 to 20mA Vibration Output


0-5/10Vdc Vibration Output – Pins 15 to 16:

- Pin 15** + 0-5/10Vdc Vibration Output
- Pin 16** - 0-5/10Vdc Vibration Output

Notes:

- Pins 3 and 4 are tied together but are NOT tied to the grounding tab on the back of the enclosure.
- Land the accelerometer cable's shield on Pin 4.
- Tie Pin 3 to either din rail ground or Earth ground with the use of an external wire.

Typical Wiring Diagram

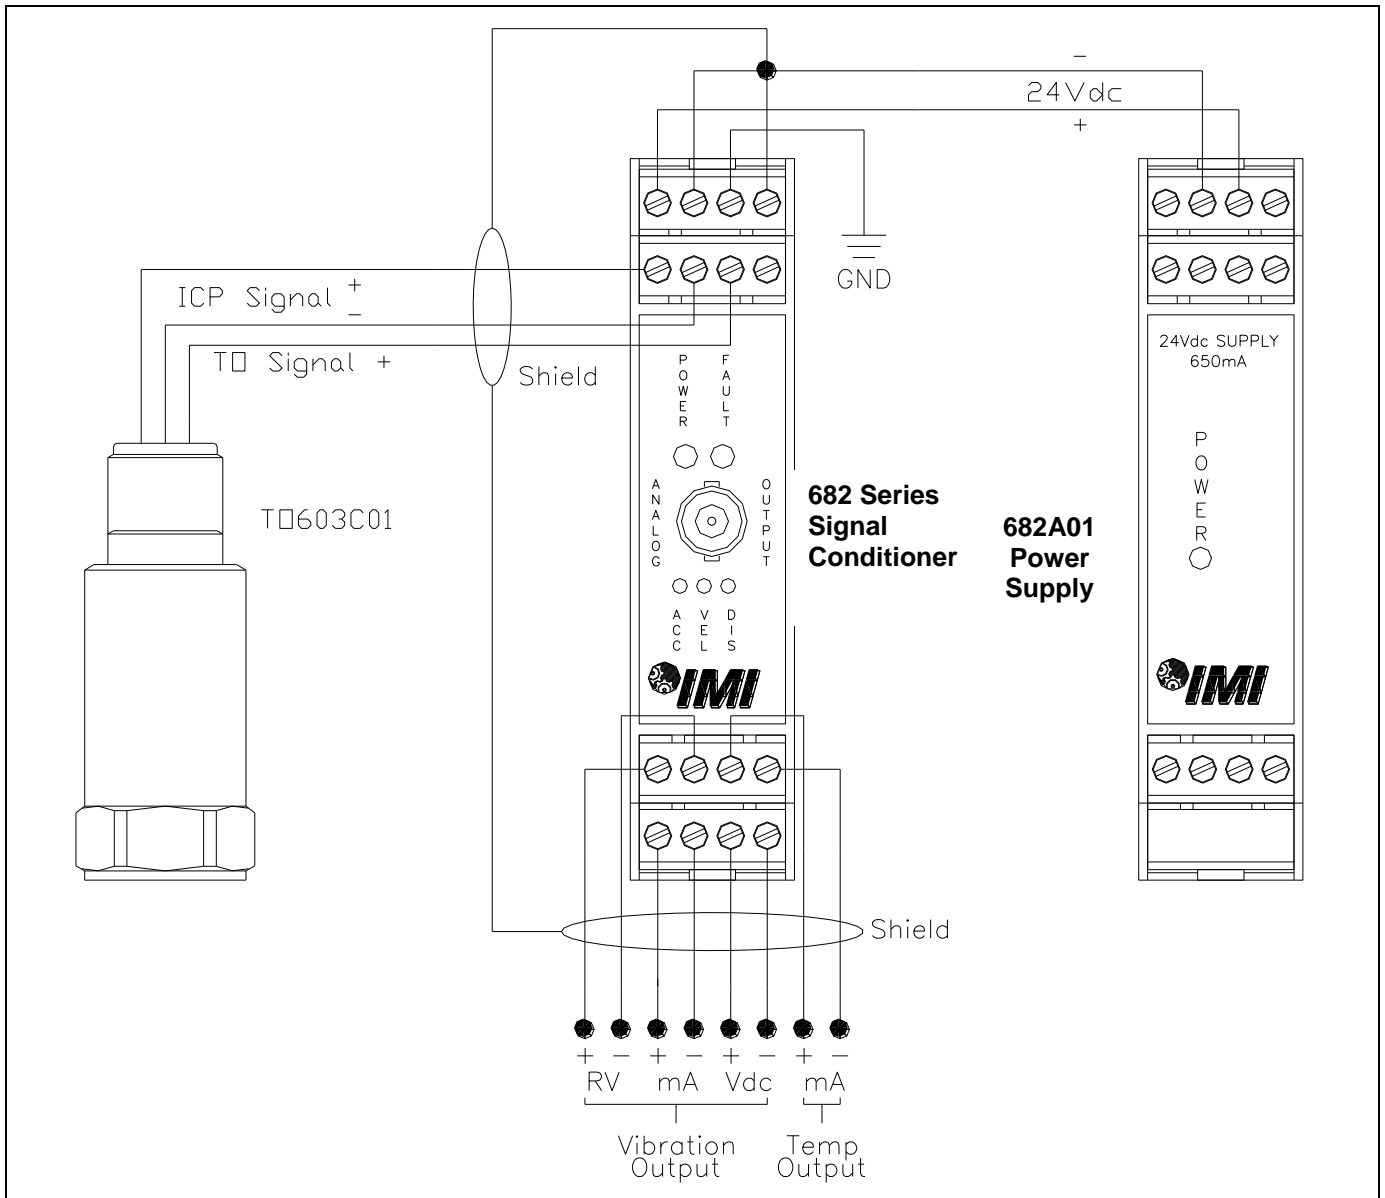

CE

To Maintain Conformance, Earth Ground, Power Supply Common, and I/O Shields must be connected together.


Note: If using the 682 Power Supply, mount the 682 Signal Conditioner to the left of the power supply with a recommended minimum separation distance of 4" where applicable.

Configuring the 682 Series

Internal PC Board Diagram

The Internal PC Board Diagram shows the location of the internal DIP Switch, Filter Modules, and Sensor Power Select Jumper. The DIP switch is used to configure the signal conditioner for various sensor and vibration ranges. The Filter Modules are installed to set the High and Low cutoff frequencies. The Jumper selects unregulated, regulated, or no ICP® power to the accelerometer.

The PC Board is accessible through the front of the indicator by removing the Screw Terminal Connectors and disengaging the tabs on the TOP and BOTTOM of the meter with a screwdriver. Once disengaged, the PC Board can be slid out for configuration.

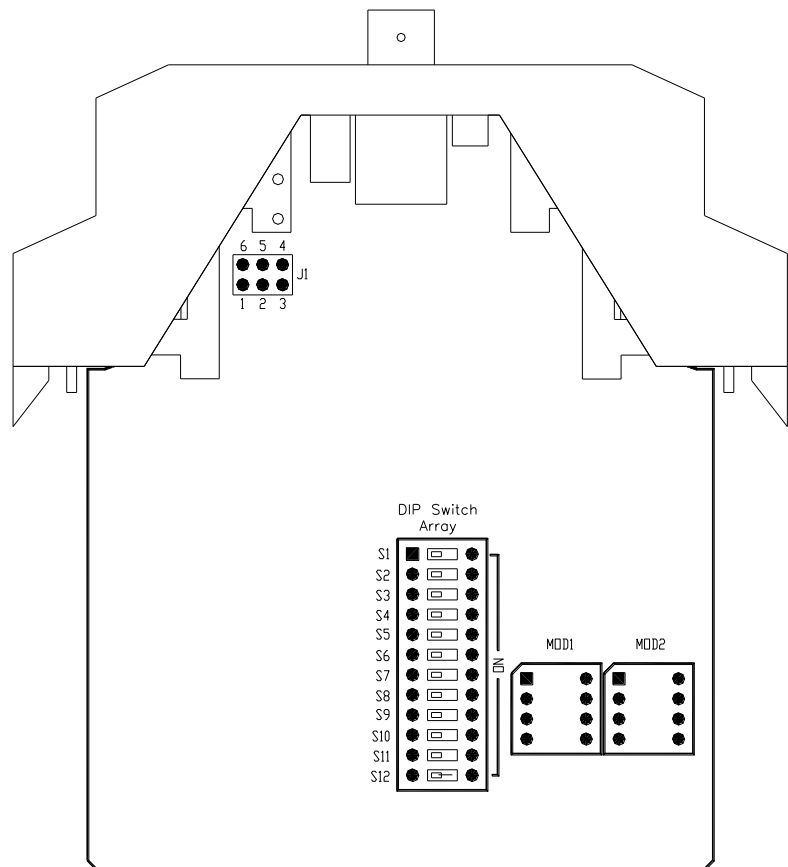

DIP Switch and Filter Module Descriptions:

- S1 and S2:** Acceleration Mode
- S3 and S4:** Velocity Mode
- S5 and S6:** Displacement Mode
- S7:** RMS
- S8:** Peak
- S9:** 20g, 2ips, 40mils

S10: 10g, 1ips, 20mils

S11: 5g, 0.5ips, 10mils

S12: Off = 0-5Vdc Output, On = 0-10Vdc Output

Internal DIP Switch Setting

The Internal DIP Switch of the 682 Series must be configured for the Full Scale Output of the ICP® Sensor connected to it. This is accomplished by removing the front cover and sliding the PC Board out of the Signal Conditioner. Once removed, the DIP switch should be configured per one of the conditions in the following table.

Range Setting	S1	S2	S3	S4	S5	S6	S7	S8	S9	S10	S11
5g RMS	ON	ON	OFF	OFF	OFF	OFF	ON	OFF	OFF	OFF	ON
5g Peak	ON	ON	OFF	OFF	OFF	OFF	OFF	ON	OFF	OFF	ON
10g RMS	ON	ON	OFF	OFF	OFF	OFF	ON	OFF	OFF	ON	OFF
10g Peak	ON	ON	OFF	OFF	OFF	OFF	OFF	ON	OFF	ON	OFF
20g RMS	ON	ON	OFF	OFF	OFF	OFF	ON	OFF	ON	OFF	OFF
20g Peak	ON	ON	OFF	OFF	OFF	OFF	OFF	ON	ON	OFF	OFF
0.5 in/sec RMS	OFF	OFF	ON	ON	OFF	OFF	ON	OFF	OFF	OFF	ON
0.5 in/sec Peak	OFF	OFF	ON	ON	OFF	OFF	OFF	ON	OFF	OFF	ON
1.0 in/sec RMS	OFF	OFF	ON	ON	OFF	OFF	ON	OFF	OFF	ON	OFF
1.0 in/sec Peak	OFF	OFF	ON	ON	OFF	OFF	OFF	ON	OFF	ON	OFF
2.0 in/sec RMS	OFF	OFF	ON	ON	OFF	OFF	ON	OFF	ON	OFF	OFF
2.0 in/sec Peak	OFF	OFF	ON	ON	OFF	OFF	OFF	ON	ON	OFF	OFF
10 mils p-p	OFF	OFF	OFF	OFF	ON	ON	OFF	OFF	OFF	OFF	ON
20 mils p-p	OFF	OFF	OFF	OFF	ON	ON	OFF	OFF	OFF	ON	OFF
40 mils p-p	OFF	OFF	OFF	OFF	ON	ON	OFF	OFF	ON	OFF	OFF

S12	OFF	0-5Vdc Output
S12	ON	0-10Vdc Output

Note: Factory Default Setting is 1.0in/sec Peak, 0-5Vdc Output

Filter Module Location

The Filter Modules are utilized to set the cutoff frequency of the internal band pass filter circuit. The 682 Series comes standard with Modules preinstalled. If a different cutoff frequency is desired, the preinstalled module can be removed by simply pulling it out of the MOD socket, and replacing it with a different module. The module is labeled with the type of filter, Low Pass or High Pass, and the cutoff frequency. Module location is as follows:


MOD1: Low Pass (LP) Filter Module Location
MOD2: High Pass (HP) Filter Module Location

Warning: Do not make any adjustments to the internal potentiometers. These potentiometers are used for factory calibration and adjusting them will require return of the 682 Series unit to the factory for recalibration.

Sensor Power Jumper Configuration:


Regulated 18Vdc/4mA Power

Jumper 2-5 and 3-4



**Unregulated 24Vdc Supply/4mA Power
(Factory Default)**


Jumper 1-6 and 3-4



Note: If there is no DC bias on the input signal, this will trigger the Open/short detection which subtracts 4mA from output

**Sensor Power Disabled
(No ICP® Power to Accelerometer)**

Jumper 1-6 and 2-3



Warning 1 – ESD sensitivity

The power supply/signal conditioner should not be opened by anyone other than qualified service personnel. This product is intended for use by qualified personnel who recognize shock hazards and are familiar with the safety precautions required to avoid injury.

Warning 2 – ESD sensitivity

This equipment is designed with user safety in mind; however, the protection provided by the equipment may be impaired if the equipment is used in a manner not specified by PCB Piezotronics, Inc.


Caution 1 – ESD sensitivity

Cables can kill your equipment. High voltage electrostatic discharge (ESD) can damage electrical devices. Similar to a capacitor, a cable can hold a charge caused by triboelectric transfer, such as that which occurs in the following:

- *Laying on and moving across a rug,*
- *Any movement through air,*
- *The action of rolling out a cable, and/or*
- *Contact with a non-grounded person.*

The PCB solution for product safety:

- *Connect the cables only with the AC power off.*
- *Temporarily “short” the end of the cable before attaching it to any signal input or output.*



CAUTION
ELECTROSTATIC
DISCHARGE SENSITIVE

Caution 2 – ESD sensitivity

ESD considerations should be made prior to performing any internal adjustments on the equipment. Any piece of electronic equipment is vulnerable to ESD when opened for adjustments. Internal adjustments should therefore be done ONLY at an ESD-safe work area. Many products have ESD protection, but the level of protection may be exceeded by extremely high voltage.

Ordering Information

IMI Part Number: **682A X 3**

Frequency Response/Isolation*

0	3Hz to 10kHz (Standard)
1	3Hz to 1kHz
2	10Hz to 10kHz
3	10Hz to 1kHz
4	3Hz to 10kHz with 500Vdc I/O Isolation
5	3Hz to 1kHz with 500Vdc I/O Isolation
6	10Hz to 10kHz with 500Vdc I/O Isolation
7	10Hz to 1kHz with 500Vdc I/O Isolation

Ordering Example: 682B13

This is a 4-20mA Din Rail ICP® Signal Conditioner with the following:
 Frequency Response: 3Hz to 1kHz
 I/O Isolation: None

***Additional Options Available – Please Inquire**

Warranty

IMI instrumentation is warranted against defective material and workmanship for 1 year unless otherwise expressly specified. Damage to instruments caused by incorrect power or misapplication, is not covered by warranty. *If there are any questions regarding power, intended application, or general usage, please consult with your local sales contact or distributor.* Batteries and other expendable hardware items are not covered by warranty.

Service

Because of the sophisticated nature of IMI instrumentation, field repair is typically **NOT** recommended and may void any warranty. If factory service is required, return the instrumentation according to the "Return Procedure" stated below. *A repair and/or replacement quotation will be provided prior to servicing at no charge.* Before returning the unit, please consult a factory IMI applications engineer concerning the situation as certain problems can often be corrected with simple on-site procedures.

Return procedure

To expedite returned instrumentation, contact a factory IMI applications engineer for a RETURN MATERIAL AUTHORIZATION (RMA) NUMBER. Please have information available such as model and serial number. Also, to insure efficient service, provide a written description of the symptoms and problems with the equipment to a local sales representative or distributor, or contact IMI if none are located in your area.

Customers outside the U.S. should consult their local IMI distributor for information on returning equipment. For exceptions, please contact the International Sales department at IMI to request shipping instructions and an RMA. For assistance, please call (716) 684-0003, or fax us at (716) 684-3823. You may also receive assistance via e-mail at imi@pcb.com or visit our web site at www.pcb.com.

Customer Service


IMI, a division of PCB Piezotronics, guarantees **Total Customer Satisfaction**. If, at any time, for any reason, you are not completely satisfied with any IMI product, IMI will repair, replace, or exchange it at no charge. You may also choose, within the warranty period, to have your purchase price refunded.

IMI offers to all customers, at no charge, 24-hour phone support. This service makes product or application support available to our customers, day or night, seven days a week. When unforeseen problems or emergency situations arise, call the **IMI Hot Line at (716) 684-0003**, and an application specialist will assist you.



3425 Walden Avenue, Depew, NY 14043-2495
Phone: (716) 684-0003 • USA Fax: (716) 684-3823 • INTL Fax: (716) 684-4703

*ICP[®] is a registered trademark of PCB Group, Incorporated,
which uniquely identifies PCB sensors that incorporate built-in microelectronics.*

Model Number 682C03		ICP® VIBRATION TRANSMITTER			Revision: A ECN #: 48518	
Performance		ENGLISH	SI	OPTIONAL VERSIONS		
Channels		1	1	Optional versions have identical specifications and accessories as listed for the standard model except where noted below. More than one option may be used.		
Input Signal(Vibration)		± 100 mV/g	± 10.2 mV/(m/s²)	[4]		
Input Signal(Temperature)		0 to 1.2 VDC	0 to 1.2 VDC	[5]		
Output Signal(DC Vibration)		4 to 20 mA	4 to 20 mA	[6]		
Output Signal(DC Vibration)		0 to 5 VDC	0 to 5 VDC	[3][7]		
Output Signal(DC Vibration)		0 to 10 VDC	0 to 10 VDC	[3][7]		
Output Signal(Temperature)		4 to 20 mA	4 to 20 mA	[5]		
Output Signal(± 0.01 %)(AC Vibration)		100 mV/g	10.2 mV/(m/s²)	[8]		
Frequency Range(-3 dB)(Acceleration)		180 to 600,000 cpm	3 to 10k Hz	[9][10][11]		
Frequency Range(-3 dB)(Velocity)		210 to 600,000 cpm	3.5 to 10k Hz	[9][10][11]		
Frequency Range(-3 dB)(Displacement)		210 to 60,000 cpm	3.5 to 1000 Hz	[9][12][10]		
Output Range(DC Acceleration)		0 to 5.00 g pk or rms	0 to 49.03 m/s² pk or rms	[3][13][4]		
Output Range(DC Acceleration)		0 to 10.00 g pk or rms	0 to 98.06 m/s² pk or rms	[3][13][4]		
Output Range(DC Acceleration)		0 to 20.00 g pk or rms	0 to 196.12 m/s² pk or rms	[3][13][4]		
Output Range(DC Velocity)		0 to 0.5 in/sec pk or rms	0 to 12.7 mm/s pk or rms	[3][13][4]		
Output Range(DC Velocity)		0 to 1.00 in/sec pk or rms	0 to 25.4 mm/s pk or rms	[3][13][4]		
Output Range(DC Velocity)		0 to 2.00 in/sec pk or rms	0 to 50.8 mm/s pk or rms	[3][13][4]		
Output Range(DC Displacement)		0 to 10.0 mil pk - pk	0 to 0.254 mm pk - pk	[3][13][4]		
Output Range(DC Displacement)		0 to 20.0 mil pk - pk	0 to 0.508 mm pk - pk	[3][13][4]		
Output Range(DC Displacement)		0 to 40.0 mil pk - pk	0 to 1.02 mm pk - pk	[3][13][4]		
Environmental						
Temperature Range(Operating)		-13 to 158 °F	-25 to 70 °C			
Temperature Range(Storage)		-40 to 257 °F	-40 to 125 °C			
Humidity Range(Non-Condensing)		0 to 95 %	0 to 95 %			
Electrical						
Power Required		DC Power	DC Power			
DC Power		23 to 25 VDC	23 to 25 VDC			
DC Power(maximum)		100 mA	100 mA			
Settling Time		<2 min	<2 min			
Excitation Voltage(delivered to sensor)		17 to 19 VDC	17 to 19 VDC	[1][2]		
Constant Current Excitation(delivered to sensor)		3 to 5 mA	3 to 5 mA	[1][2]		
Output Span(± 5.0 %)(DC Vibration Current Output)		16 mA	16 mA			
Output Span(± 5.0 %)(Temperature Output)		16 mA	16 mA			
Output Span(± 5.0 %)(DC Vibration Voltage Output)		5 or 10 VDC	5 or 10 VDC	[3]		
Physical						
Electrical Connector(input/output)		Removable Screw Terminals	Removable Screw Terminals			
Electrical Connector(raw vibration output)		BNC Jack	BNC Jack			
Housing Material		Polyamide	Polyamide			
Size (Height x Width x Depth)		3.9 in x 0.9 in x 4.5 in	99 mm x 22.5 mm x 114.5 mm			
Weight(Maximum)		6.4 oz	127			
Screw Terminal Wire Size		24-14 AWG	24-14 AWG			
Din Rail Mount		1.38 in	35 mm			
Status Indicator(Power "on")		Green LED	Green LED			
Status Indicator(Input Fault)		Red LED	Red LED			
Status Indicator(Measurement Mode - Acceleration)		Green LED	Green LED			
Status Indicator(Measurement Mode - Velocity)		Green LED	Green LED			
Status Indicator(Measurement Mode - Displacement)		Green LED	Green LED			
[14]						
All specifications are at room temperature unless otherwise specified. In the interest of constant product improvement, we reserve the right to change specifications without notice.						
ICP® is a registered trademark of PCB Group, Inc.						
<div><div><div>IMI SENSORS A PCB PIEZOTRONICS DIV. 3425 Walden Avenue, Depew, NY 14043</div></div><div><div>Phone: 800-959-4464 Fax: 716-684-3823 E-Mail: imi@pcb.com</div></div></div>						





All specifications are at room temperature unless otherwise specified.
In the interest of constant product improvement, we reserve the right to change specifications without notice.

ICP® is a registered trademark of PCB Group, Inc.

A

.260 [6.60]

 **IMI SENSORS** 

A PCB PIEZOTRONICS DIV.

4-20mA Signal Conditioner

Model Number:


Serial Number:


Supply Voltage: +24Vdc

Supply Current: 100mA

ICP[®] Driver: 4ma/18Vdc

ICP IS A REGISTERED TRADEMARK OF PCB GROUP INC.

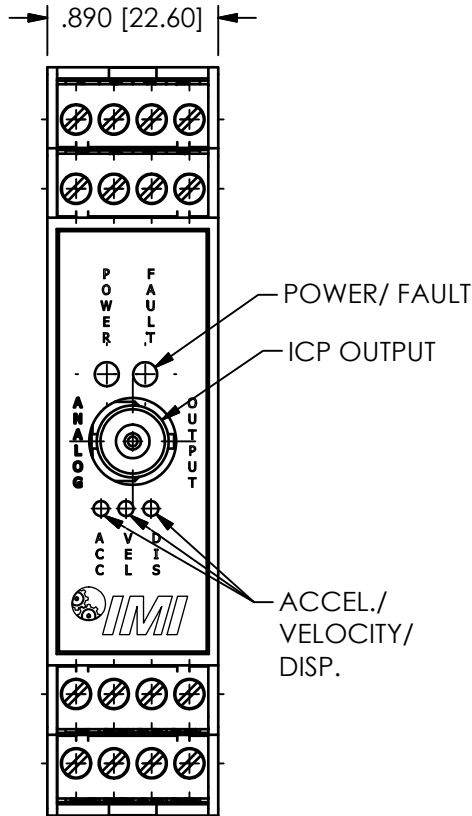

UNLESS OTHERWISE SPECIFIED TOLERANCES ARE:		DRAWN		CHECKED		ENGINEER		 PCB PIEZOTRONICS™ 3425 WALDEN AVE. DEPEW, NY 14043 (716) 684-0001 E-MAIL: sales@pcb.com
DIMENSIONS IN INCHES	DIMENSIONS IN MILLIMETERS [IN BRACKETS]	JDM	5/31/16	ECB	5/31/16	CPH	5/31/16	
DECIMALS XX ±.03 XXX ±.010	DECIMALS X ± 0.8 XX ± 0.25	TITLE OUTLINE DRAWING 4-20 DIN RAIL CONDITIONER						
ANGLES ± 2 DEGREES	ANGLES ± 2 DEGREES							
FILLETS AND RADII .003 - .005	FILLETS AND RADII 0.07 - 0.13	CODE IDENT. NO. 52681		DWG. NO. 40537				
		SCALE: FULL		SHEET 1 OF 1				