

HS-420I/M Intrinsically Safe Accelerometer


4-20mA velocity output via M12 Connector

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Customisable features

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

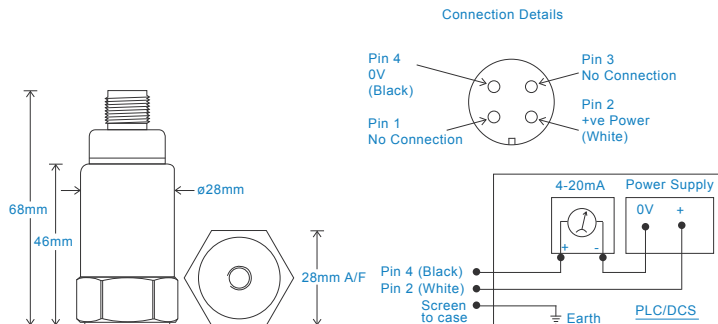

Technical Performance

Mounted Base Resonance	5kHz min
Velocity Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 1kHz (60kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Screened Cable Assembly	HS-AC010 - straight HS-AC011 - right angle
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to Velocity Range
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	>10 ⁸ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP67
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

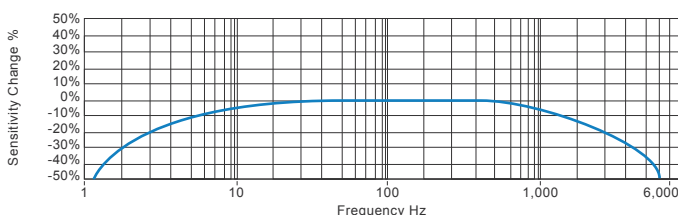

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS064.21




4-20mA velocity output via M12 Connector

Intrinsically Safe Requirements

Maximum Cable Length	See website: www.hansfordensors.com see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
			Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C
Certificate details: Group I + II	IECEX BAS08.0034X Baseefa08ATEX0086X		Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C
	Ⓜ II 1GD Ex ia IIC T6 Ga Ex ia IIIC T80°C IP65 Da Ⓜ I M1 Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Barrier	1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	Ⓜ II 1GD Ex ia IIC T4 Ga Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)		1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
		System Connections for Zener Barrier	see attached system drawings
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Galvanic Isolator	see attached system drawings
		Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I		
		Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
500V Isolation	Units Will Pass A 500V Isolation Test		
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)		
Australia Approval Group 1	IECEX ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

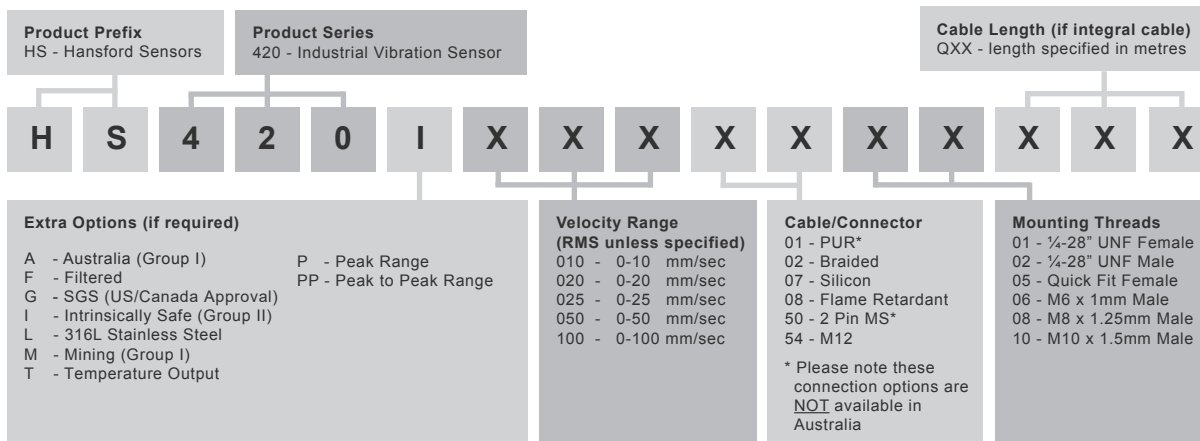

www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice.



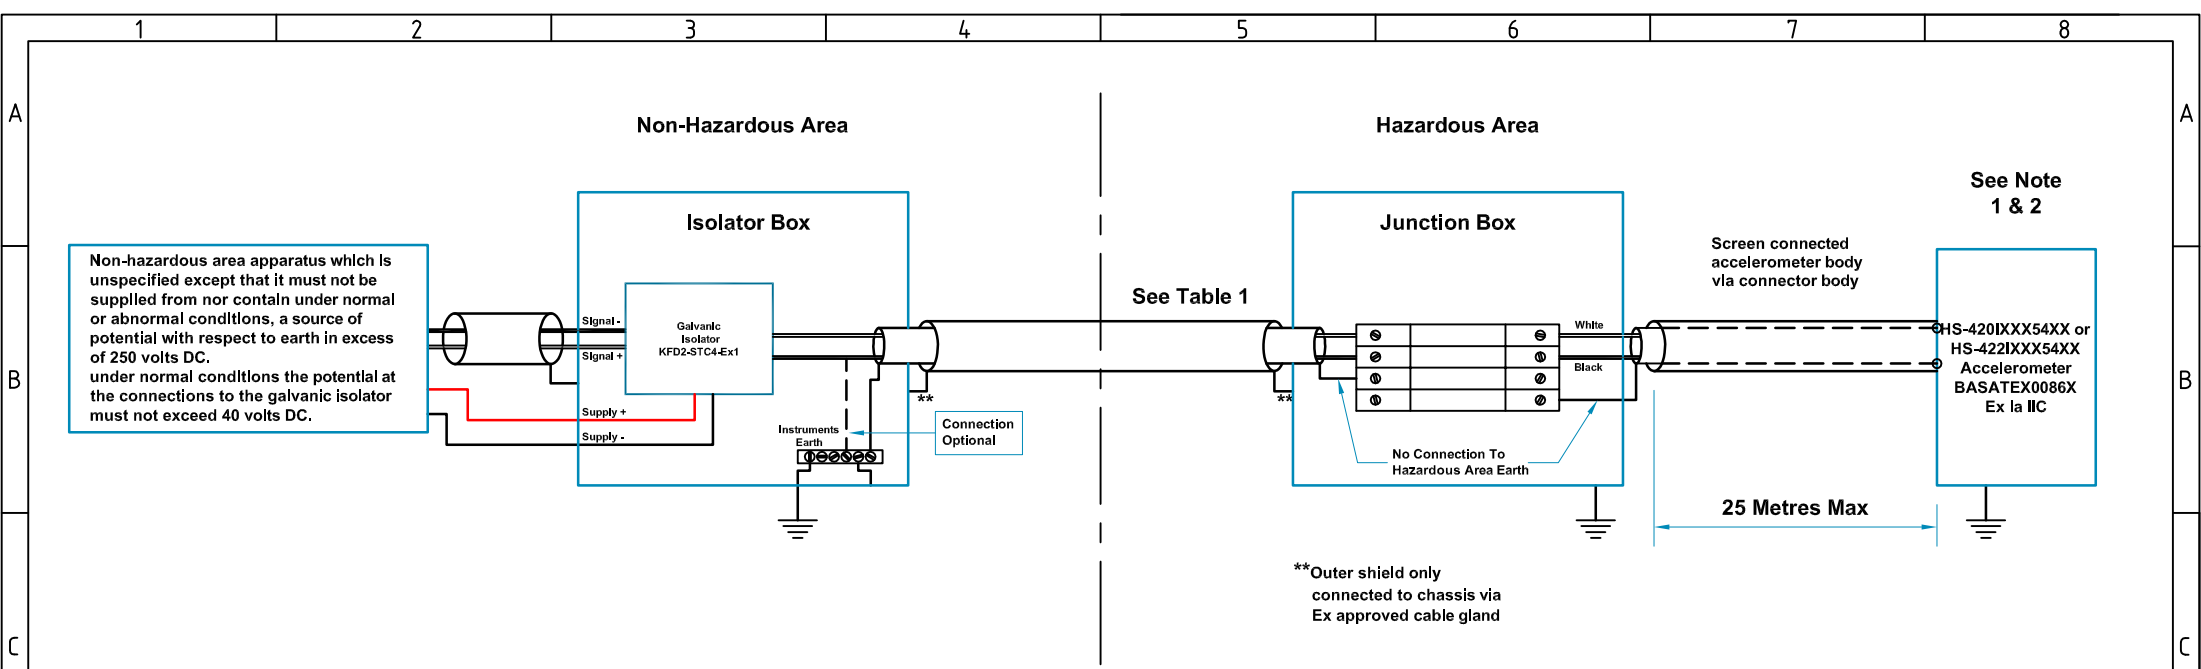


Table 1: Cable Connecting The Connector Version

Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$
IIC	0.096	72
IIB	0.767	277
IIA	2.597	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Notes:


1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The Installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By
A	Release	31/03/08	MJS	CMH

Material: N/A	
Tolerances Unless Stated	
0 or 0.0	±0.5
0.00	±0.15
Angle	±5°
Finish All Over Threads g6 H6	

Hansford Sensors
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE

 **Do Not Scale**

All Dimensions In mm Unless Otherwise Stated


If In Doubt - Ask!

Description: System Connections For HS-420I & HS-422I Group II Accelerometers With Connectors F.U.W. Galvanic Isolation

Drawing No: M06-034-A

Scale: NTS
Sheet: 1 of 1

Form Number: QF024 Issue 1

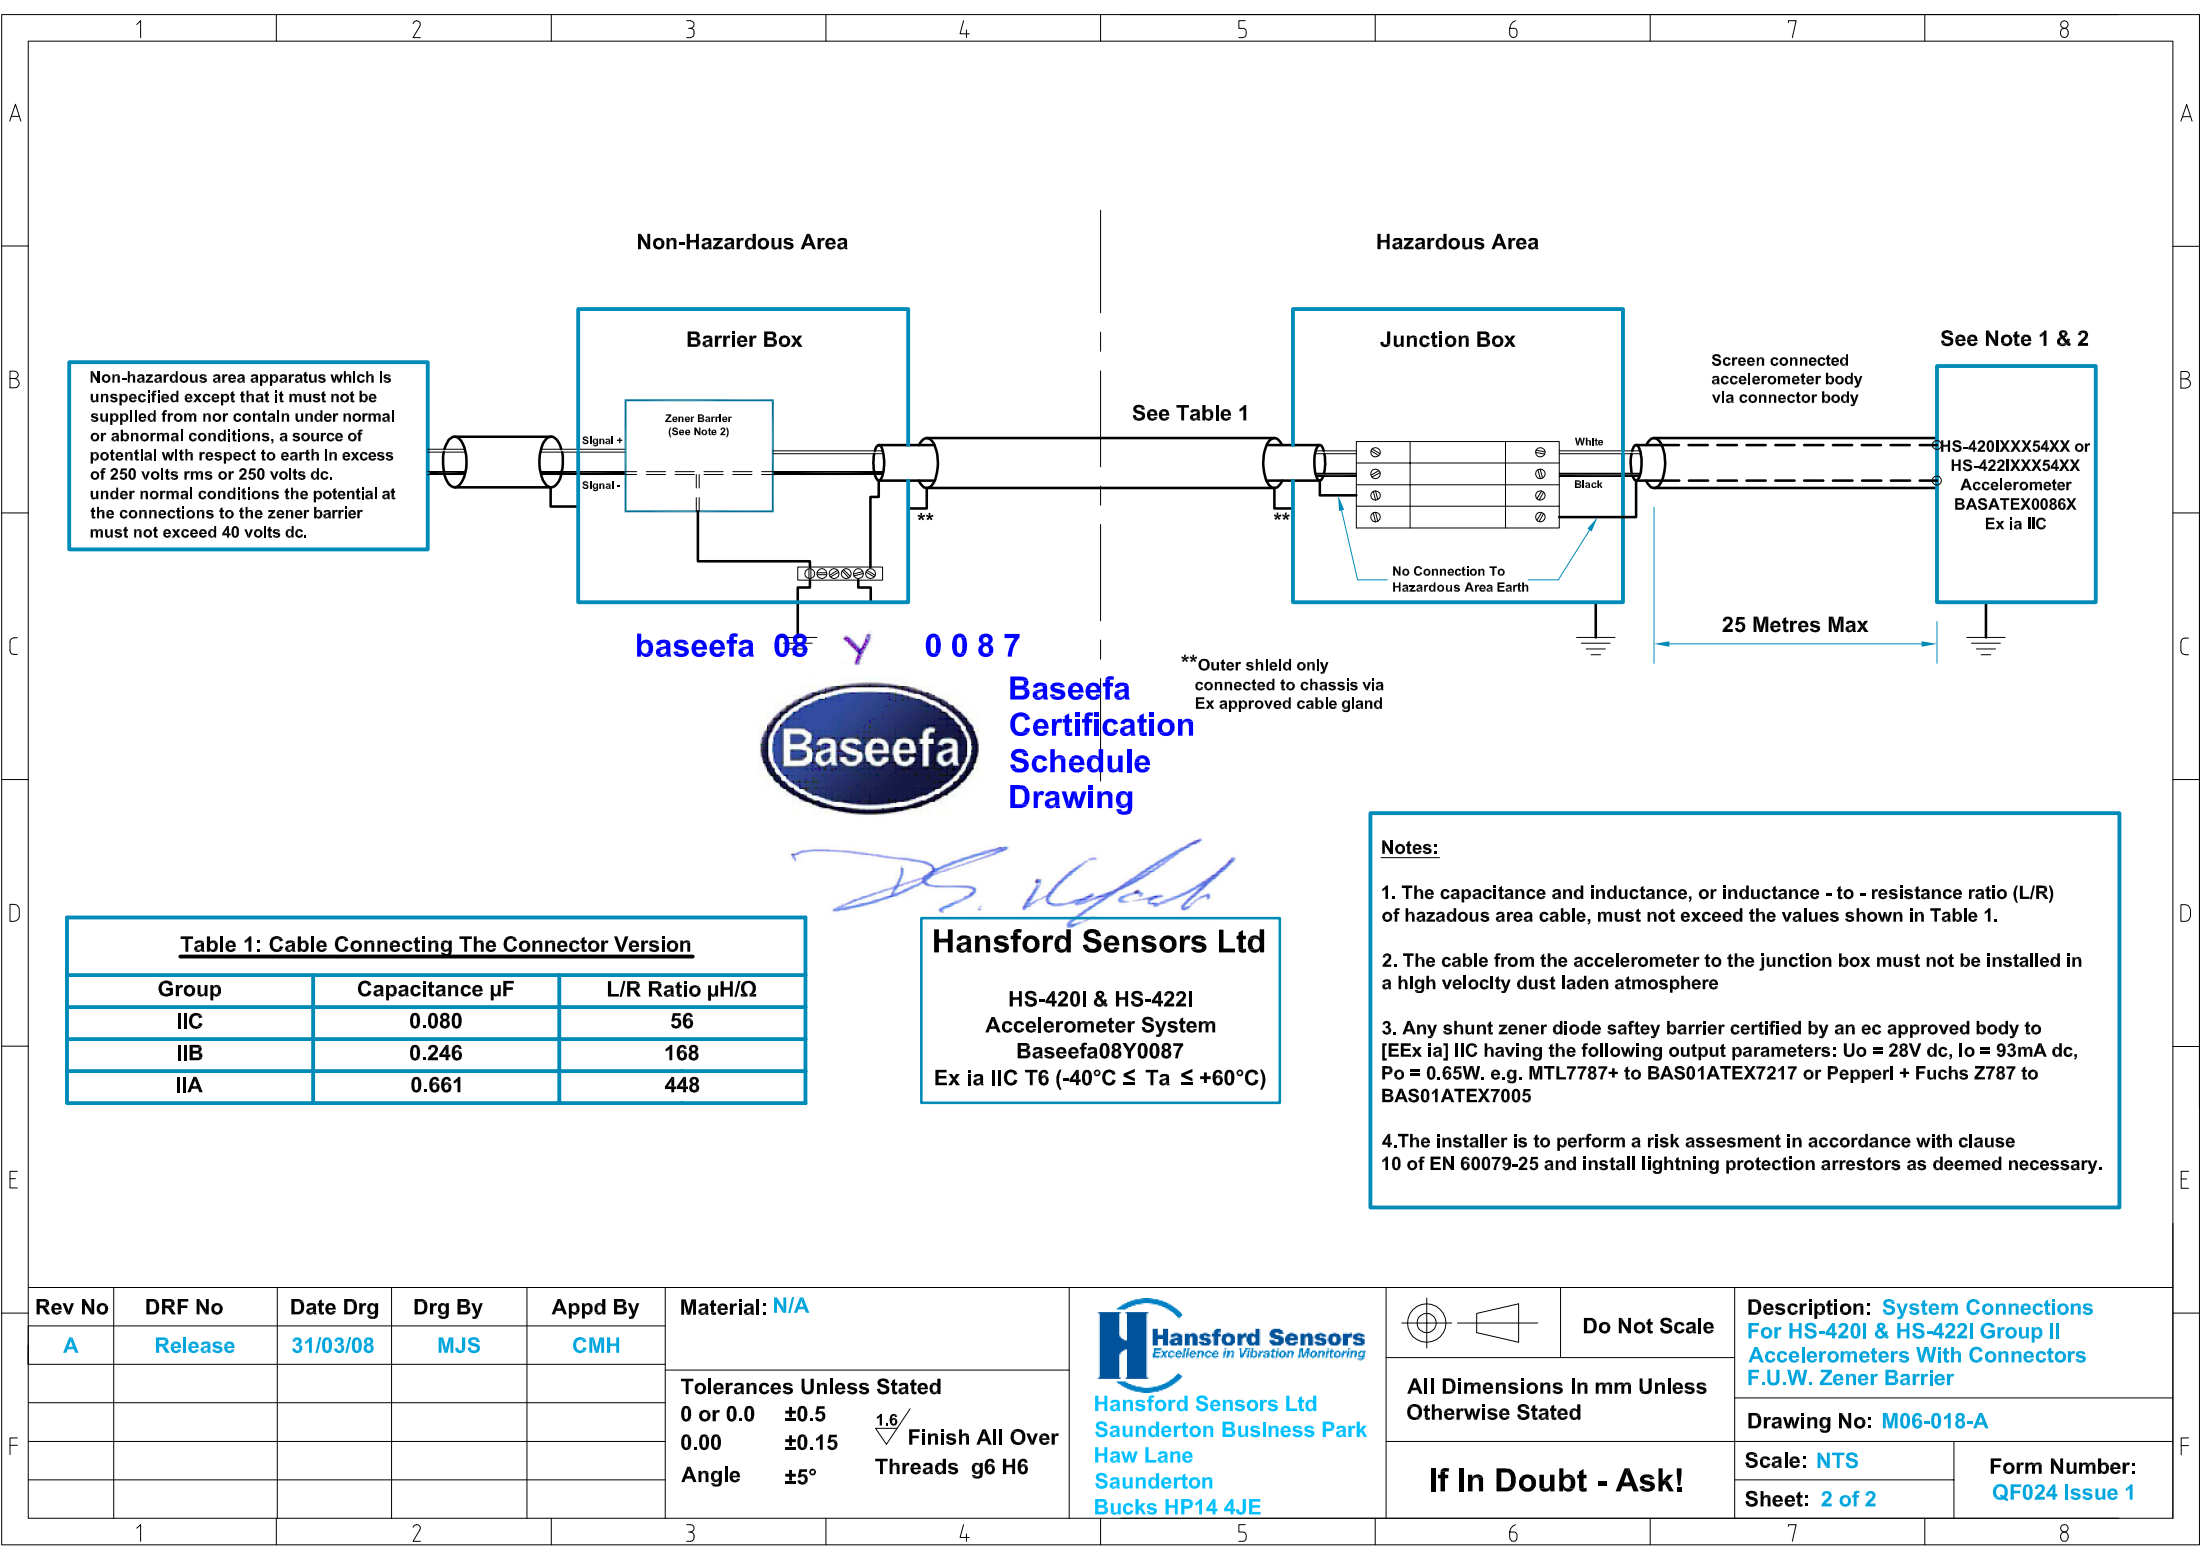


Rev No	DRF No	Date Drg	Drg By	Appd By
A	Release	31/03/08	MJS	CMH

Material: N/A	
Tolerances Unless Stated	
0 or 0.0	±0.5
0.00	±0.15
Angle	±5°
Finish All Over Threads g6 H6	



Hansford Sensors
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE



Do Not Scale

All Dimensions In mm Unless Otherwise Stated

If In Doubt - Ask!

Description: **System Connections For HS-4201 & HS-4221 Group II Accelerometers With Connectors F.U.W. Zener Barrier**

Drawing No: **M06-018-A**

Scale: NTS	Form Number: QF024 Issue 1
Sheet: 2 of 2	

HS-420I/M Intrinsically Safe Accelerometer


4-20mA velocity output via 2 Pin MS Connector

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Customisable features

Industries

Building services, Pulp and Paper,
Mining, Metals, Utilities, Automotive,
Water, Pharmaceutical

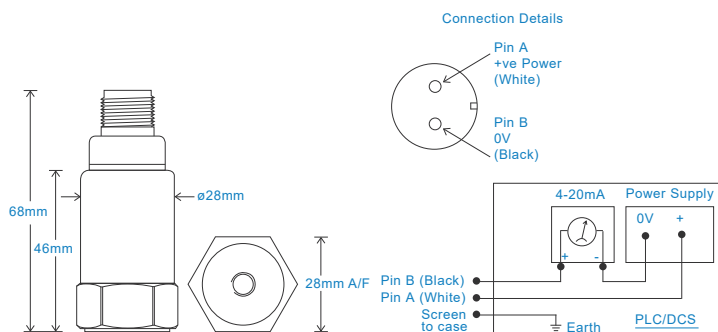

Technical Performance

Mounted Base Resonance	5kHz min
Velocity Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 1kHz (60kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Screened Cable Assembly	see: www.hansfordsensors.com for options
Connector	HS-AA004 - non-booted HS-AA053 or HS-AA054 - booted
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to Velocity Range
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP68
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

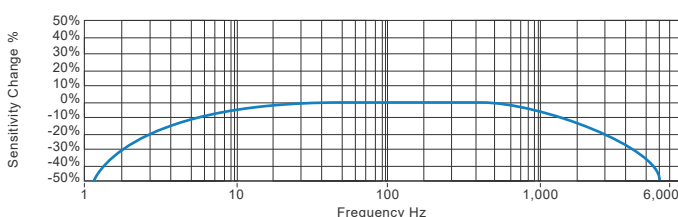

Applications

Fans, Motors, Pumps, Compressors,
Centrifuges, Conveyors, Air Handlers,
Gearboxes, Rolls, Dryers, Presses,
Cooling, VAC, Spindles, Machine Tooling,
Process Equipment

Vibration sensor should be firmly fixed to a flat surface
(spot face surface may be needed to be produced and
cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS416.17




HS-420I/M Intrinsically Safe Accelerometer


4-20mA velocity output via 2 Pin MS Connector

Intrinsically Safe Requirements


Maximum Cable Length	See website: www.hansfordsensors.com see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231 Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIC, T130°C, IP65, Da, -40°C to +110°C
Certificate details: Group I + II	IECEX BAS08.0034X Baseefa08ATEX0086X ⓈII 1GD Ex ia IIC T6 Ga Ex ia IIC T80°C IP65 Da ⓈI M1 Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Barrier	1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	ⓈII 1GD Ex ia IIC T4 Ga Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)		1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
		System Connections for Galvanic Isolator	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
500V Isolation	Units Will Pass A 500V Isolation Test	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)		
Australia Approval Group 1	IECEX ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

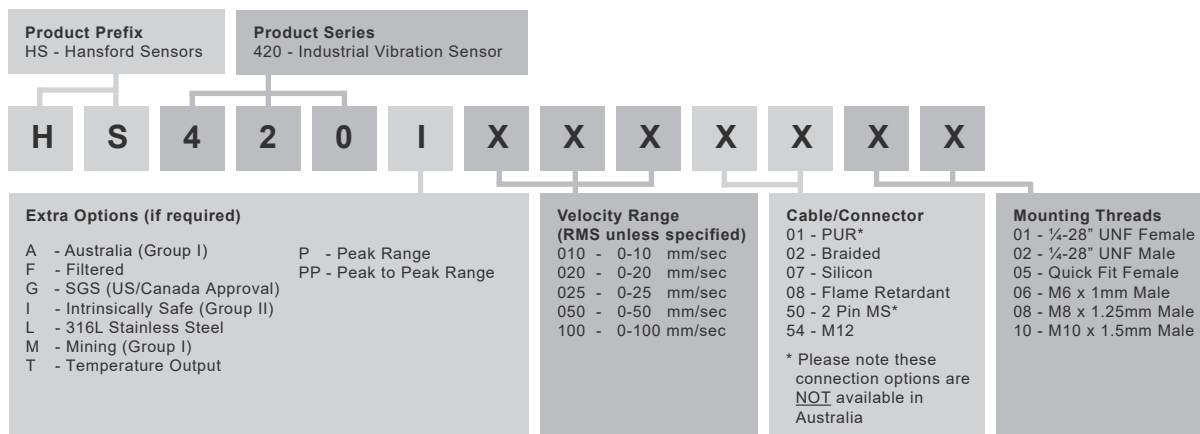

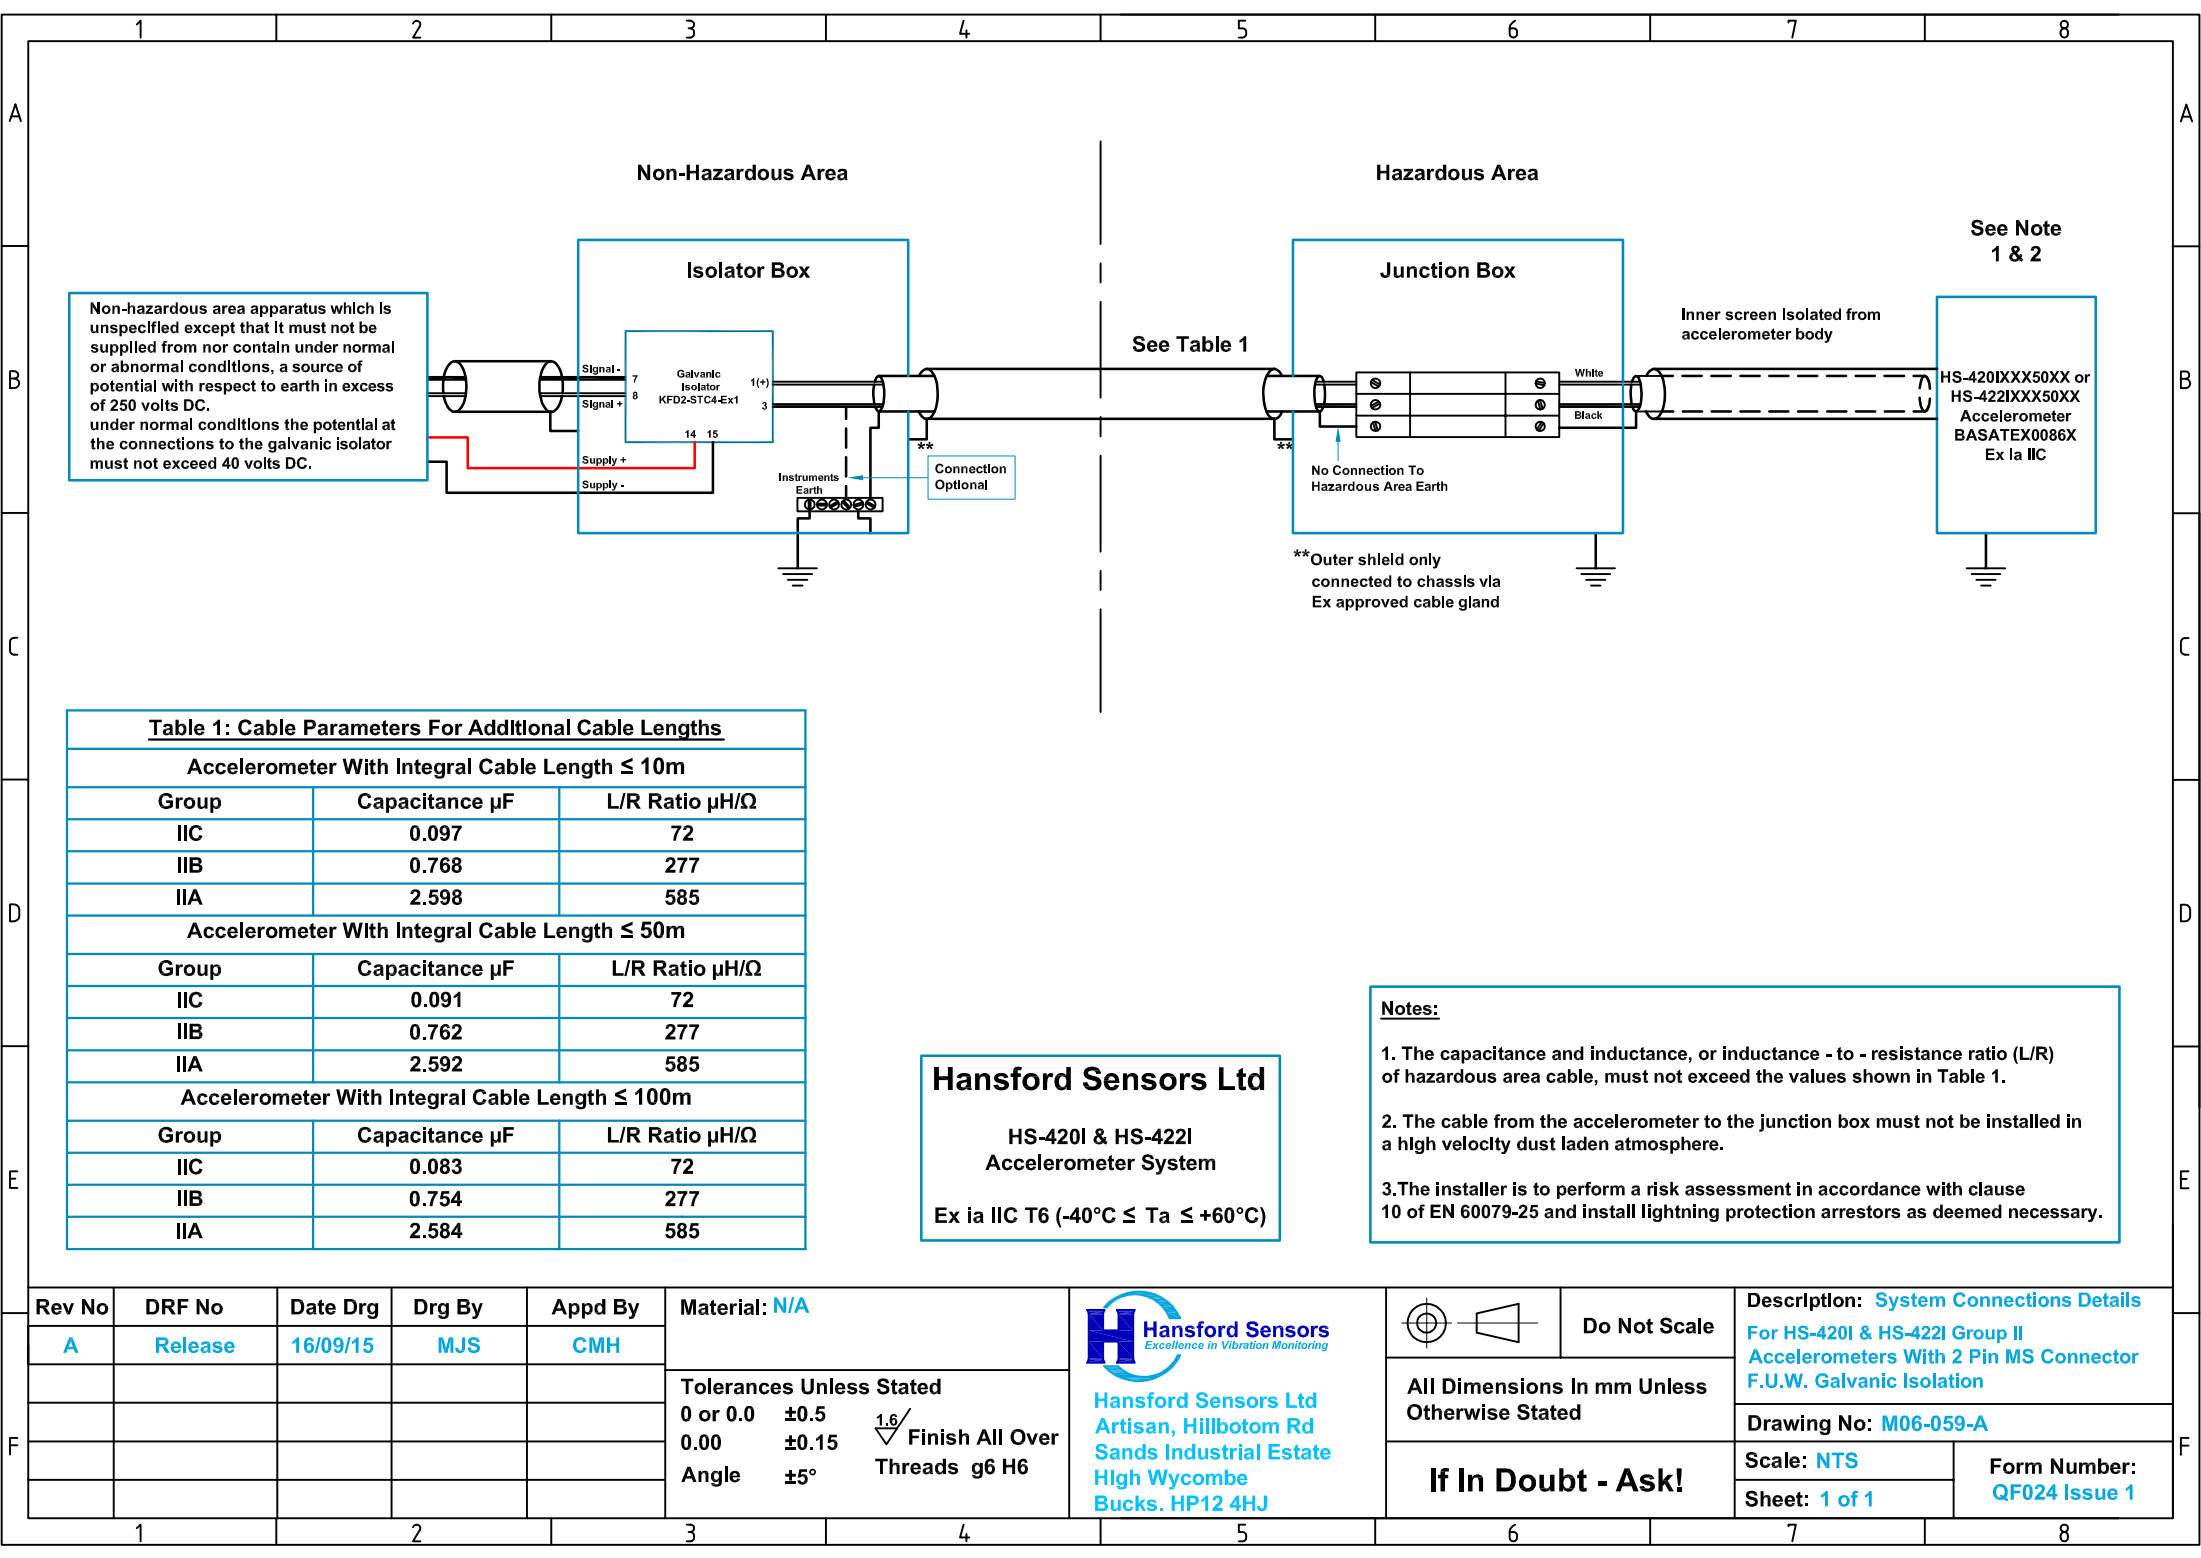


Non-hazardous area apparatus which is unspecified except that It must not be supplied from nor contain under normal or abnormal conditions, a source of potential with respect to earth in excess of 250 volts DC.
under normal conditions the potential at the connections to the galvanic isolator must not exceed 40 volts DC.

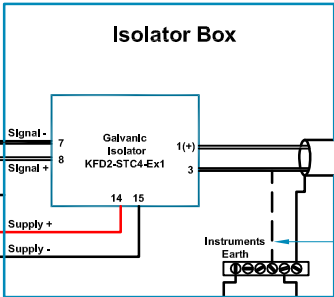

Connection Optional

See Table 1

**Outer shield only connected to chassis via Ex approved cable gland



Inner screen Isolated from accelerometer body

See Note 1 & 2

HS-420I/XX50XX or HS-422I/XX50XX Accelerometer BASATEX0086X Ex Ia IIC

Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length ≤ 10m

Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585

Accelerometer With Integral Cable Length ≤ 50m

Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.091	72
IIB	0.762	277
IIA	2.592	585

Accelerometer With Integral Cable Length ≤ 100m

Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.083	72
IIB	0.754	277
IIA	2.584	585

Hansford Sensors Ltd

HS-420I & HS-422I Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Notes:

- 1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
- 2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
- 3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.


Rev No	DRF No	Date Drg	Drg By	Appd By
A	Release	16/09/15	MJS	CMH

Material: N/A	
Tolerances Unless Stated	
0 or 0.0	±0.5
0.00	±0.15
Angle	±5°
Finish All Over Threads g6 H6	



Hansford Sensors
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Artisan, Hillbottom Rd
Sands Industrial Estate
High Wycombe
Bucks. HP12 4HJ



Do Not Scale

All Dimensions In mm Unless Otherwise Stated

If In Doubt - Ask!

Description: System Connections Details
For HS-420I & HS-422I Group II Accelerometers With 2 Pin MS Connector F.U.W. Galvanic Isolation

Drawing No: M06-059-A

Scale: NTS

Form Number: QF024 Issue 1

Sheet: 1 of 1

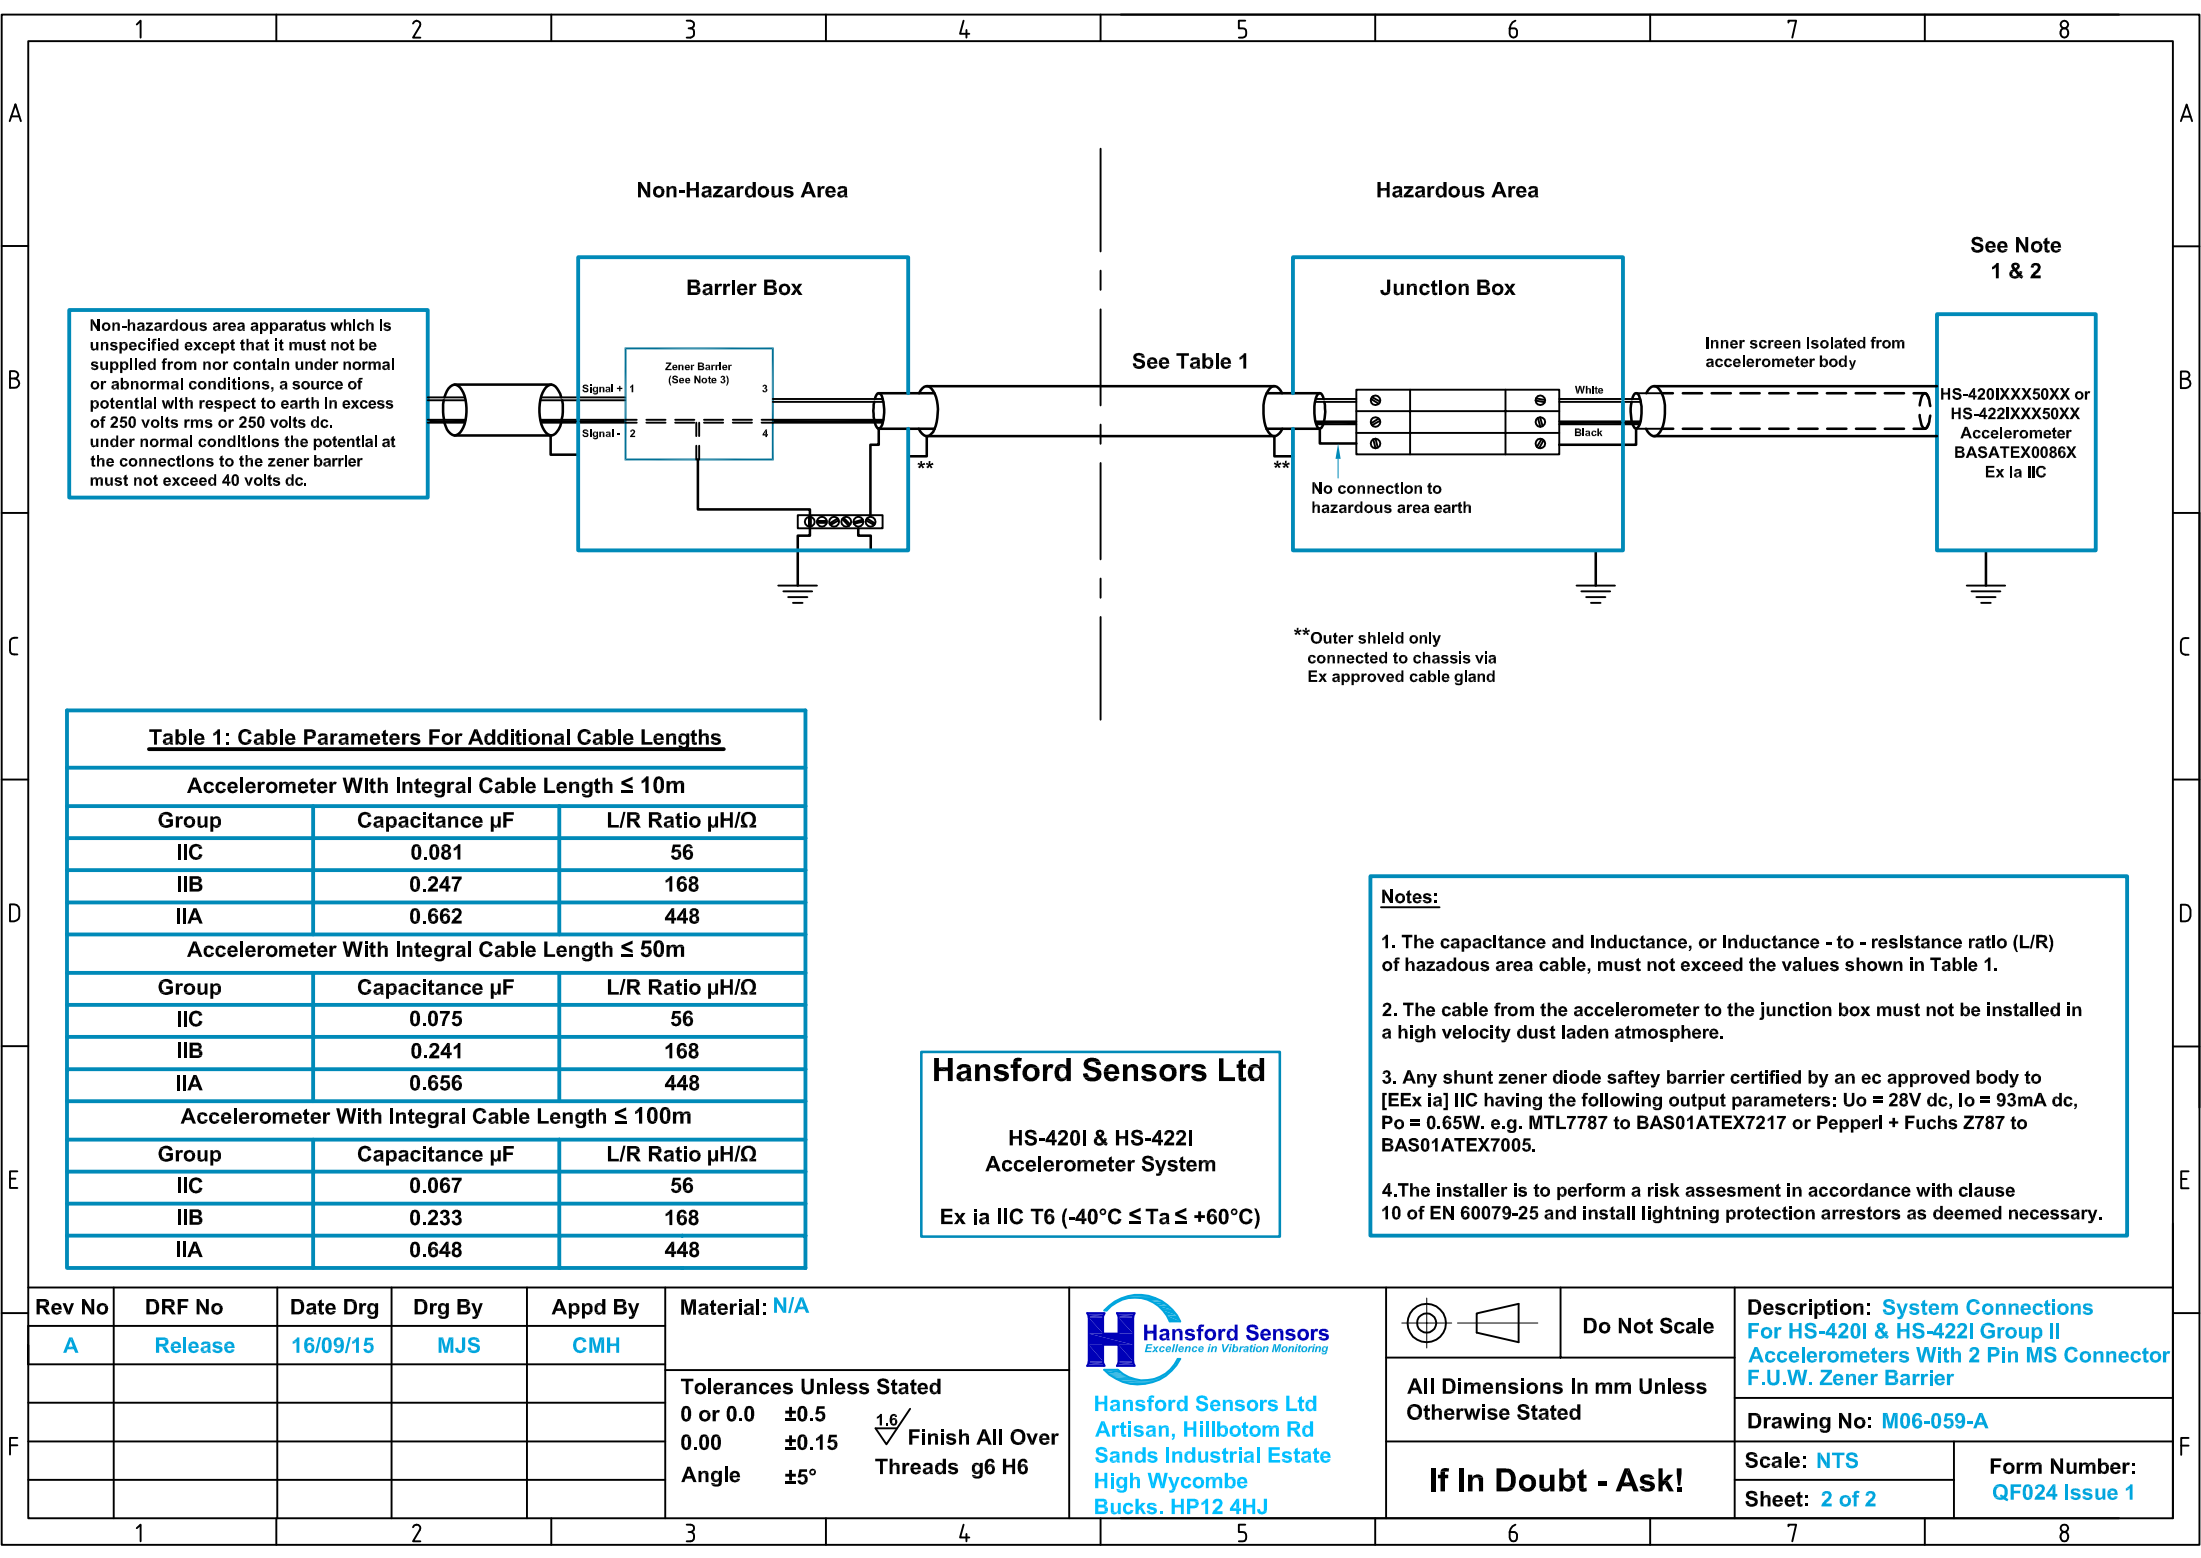


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length ≤ 10m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.081	56
IIB	0.247	168
IIA	0.662	448
Accelerometer With Integral Cable Length ≤ 50m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.075	56
IIB	0.241	168
IIA	0.656	448
Accelerometer With Integral Cable Length ≤ 100m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.067	56
IIB	0.233	168
IIA	0.648	448

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

- Notes:**
- The capacitance and Inductance, or Inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
 - The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
 - Any shunt zener diode safety barrier certified by an ec approved body to [EEEx ia] IIC having the following output parameters: Uo = 28V dc, Io = 93mA dc, Po = 0.65W. e.g. MTL7787 to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005.
 - The installer is to perform a risk assesment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By
A	Release	16/09/15	MJS	CMH

Material: N/A


Tolerances Unless Stated

0 or 0.0 ±0.5
0.00 ±0.15
Angle ±5°

1.6/ Finish All Over
Threads g6 H6

Hansford Sensors
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Artisan, Hillbottom Rd
Sands Industrial Estate
High Wycombe
Bucks. HP12 4HJ

 Do Not Scale

All Dimensions In mm Unless
Otherwise Stated

If In Doubt - Ask!

Description: System Connections
For HS-420I & HS-422I Group II
Accelerometers With 2 Pin MS Connector
F.U.W. Zener Barrier

Drawing No: M06-059-A

Scale: NTS
Sheet: 2 of 2

Form Number:
QF024 Issue 1

HS-420I/M Intrinsically Safe Accelerometer


4-20mA velocity output via Flame Retardant Cable for use with Terminal Head

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with Terminal Head
- Customizable features

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

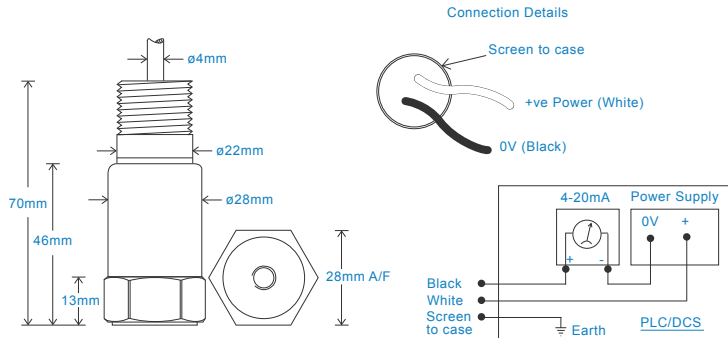

Technical Performance

Mounted Base Resonance	5kHz min
Velocity Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 1kHz (60kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
External Cable Length	site cable up to 1000 metres
Integral Cable Length	up to 300 mm
Cable Connections	Screw Terminals
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to Velocity Range
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP65
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

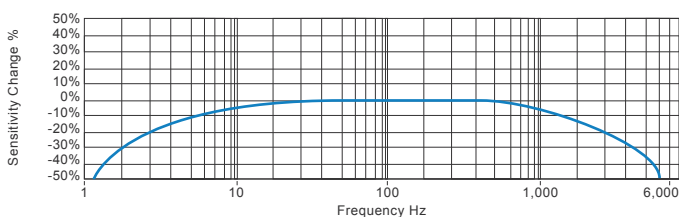

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
 TS080.23




HS-420I/M Intrinsically Safe Accelerometer

4-20mA velocity output via Flame Retardant Cable for use with Terminal Head

Intrinsically Safe Requirements

Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231 Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIC, T130°C, IP65, Da, -40°C to +110°C
Certificate details: Group I + II	IECEX BAS08.0034X Baseefa08ATEX0086X Ex ia IIC T6 Ga Ex ia IIC T80°C IP65 Da Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Barrier	1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings 1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Certificate details: Group II	Ex ia IIC T4 Ga Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)		
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
		System Connections for Galvanic Isolator	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
500V Isolation	Units Will Pass A 500V Isolation Test	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)		
Australia Approval Group 1	IECEX ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

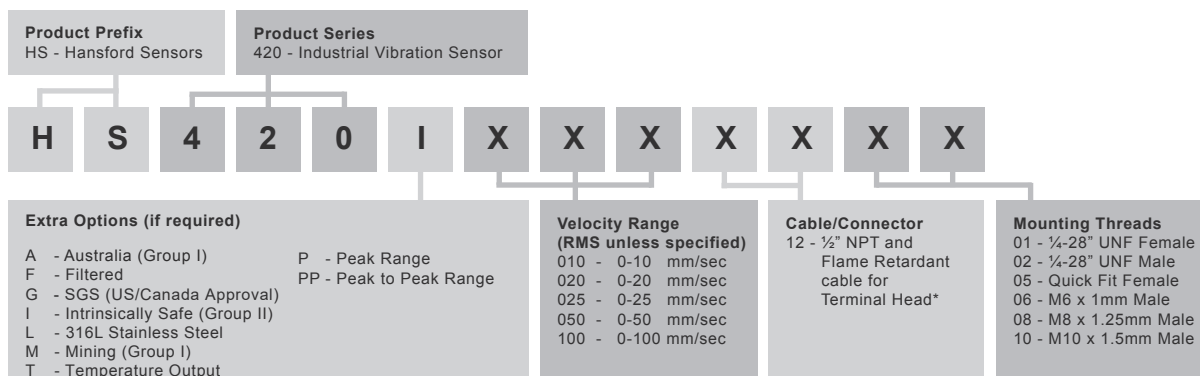

*HS-AA042 or HS-AA052 Terminal Head to be purchased separately

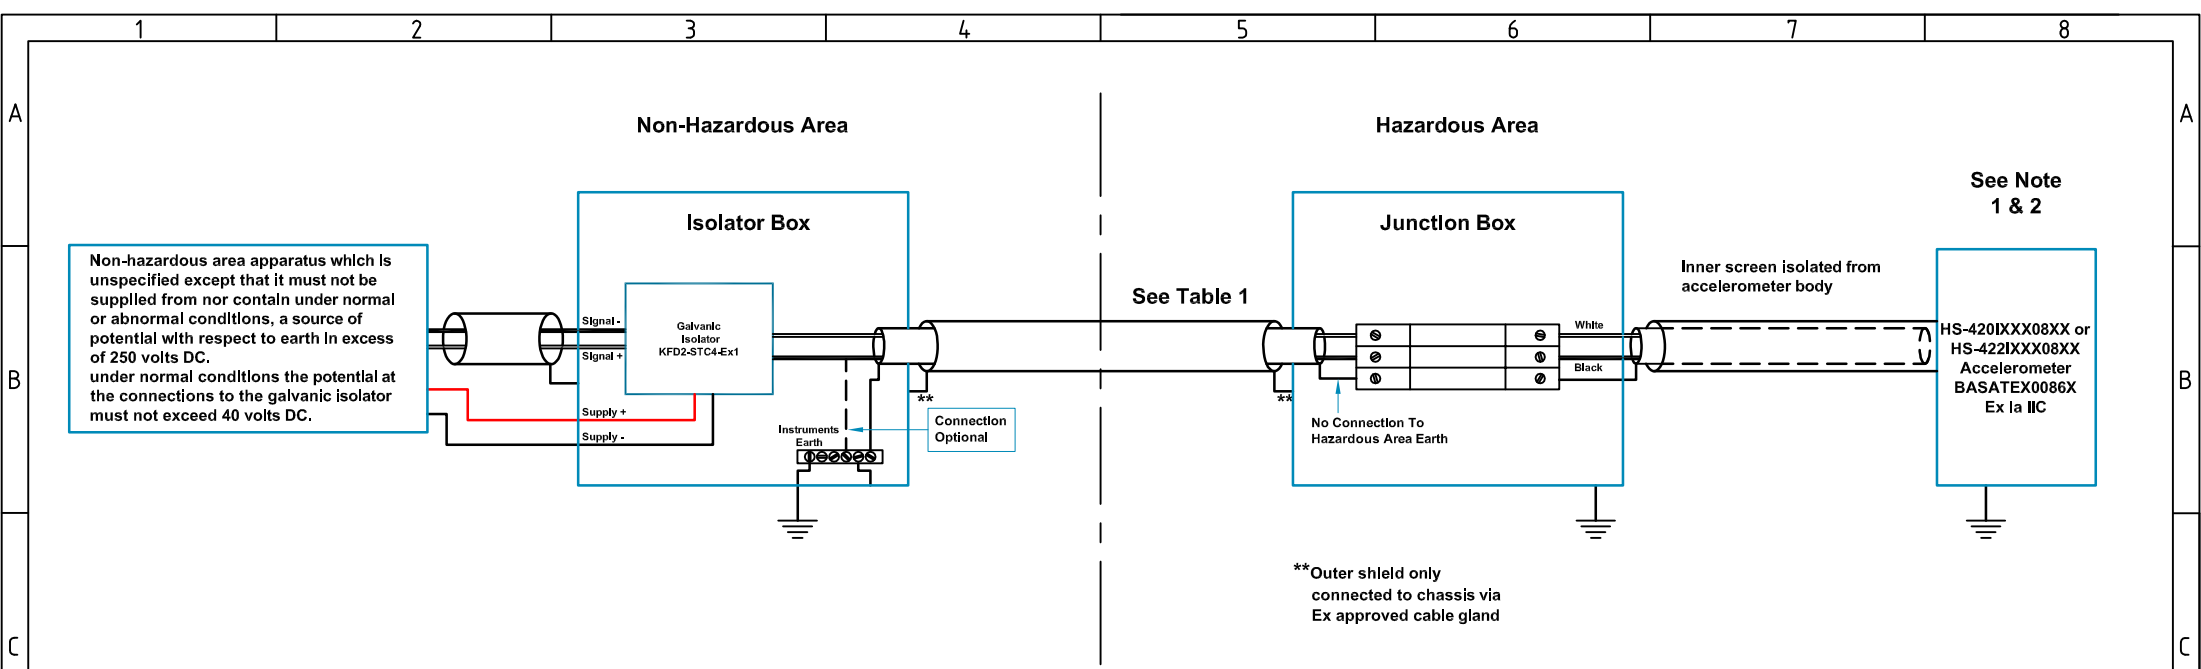


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length ≤ 10m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585
Accelerometer With Integral Cable Length ≤ 50m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.091	72
IIB	0.762	277
IIA	2.592	585
Accelerometer With Integral Cable Length ≤ 100m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.083	72
IIB	0.754	277
IIA	2.584	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Notes:


1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By
A	Release	17/06/10	MJS	CMH

Material: N/A	
Tolerances Unless Stated	
0 or 0.0	±0.5
0.00	±0.15
Angle	±5°
Finish All Over Threads g6 H6	

**Hansford Sensors**
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE

 **Do Not Scale**

All Dimensions In mm Unless
Otherwise Stated

If In Doubt - Ask!

Description: **System Connections**
For HS-420I & HS-422I Group II
Accelerometers With Non Armoured
FR Polyurethane Cable
F.U.W. Galvanic Isolation

Drawing No: **M06-033-A**

Scale: **NTS**

Sheet: **1 of 1**

Form Number:
QF024 Issue 1

HS-420I/M Intrinsically Safe Accelerometer


4-20mA velocity output via Flame Retardant Cable for use with Terminal Head

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with Terminal Head
- Customizable features

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

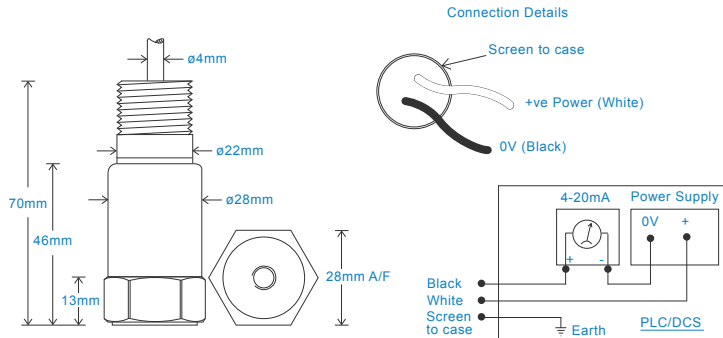

Technical Performance

Mounted Base Resonance	5kHz min
Velocity Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 1kHz (60kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
External Cable Length	site cable up to 1000 metres
Integral Cable Length	up to 300 mm
Cable Connections	Screw Terminals
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to Velocity Range
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP65
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

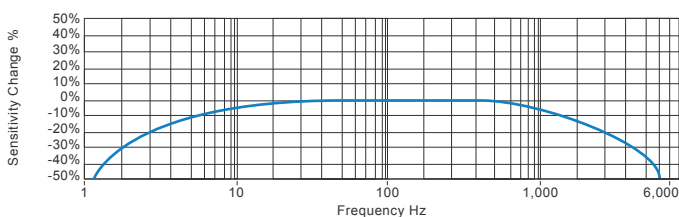

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS080.23




HS-420I/M Intrinsically Safe Accelerometer

4-20mA velocity output via Flame Retardant Cable for use with Terminal Head

Intrinsically Safe Requirements

Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231 Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIC, T130°C, IP65, Da, -40°C to +110°C
Certificate details: Group I + II	IECEX BAS08.0034X Baseefa08ATEX0086X ⓂII 1GD Ex ia IIC T6 Ga Ex ia IIC T80°C IP65 Da ⓂI M1 Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Barrier	1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings 1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Certificate details: Group II	ⓂII 1GD Ex ia IIC T4 Ga Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)	System Connections for Zener Barrier	see attached system drawings
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Galvanic Isolator	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
500V Isolation	Units Will Pass A 500V Isolation Test	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)		
Australia Approval Group 1	IECEX ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

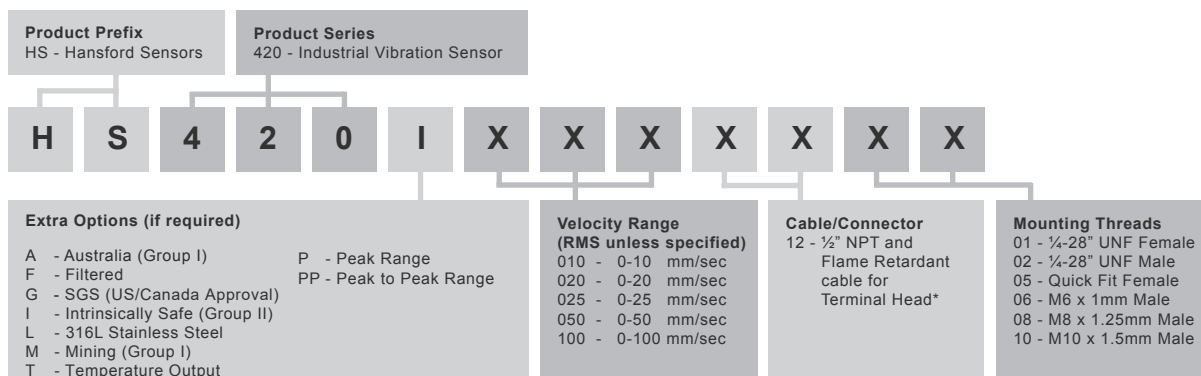

*HS-AA042 or HS-AA052 Terminal Head to be purchased separately

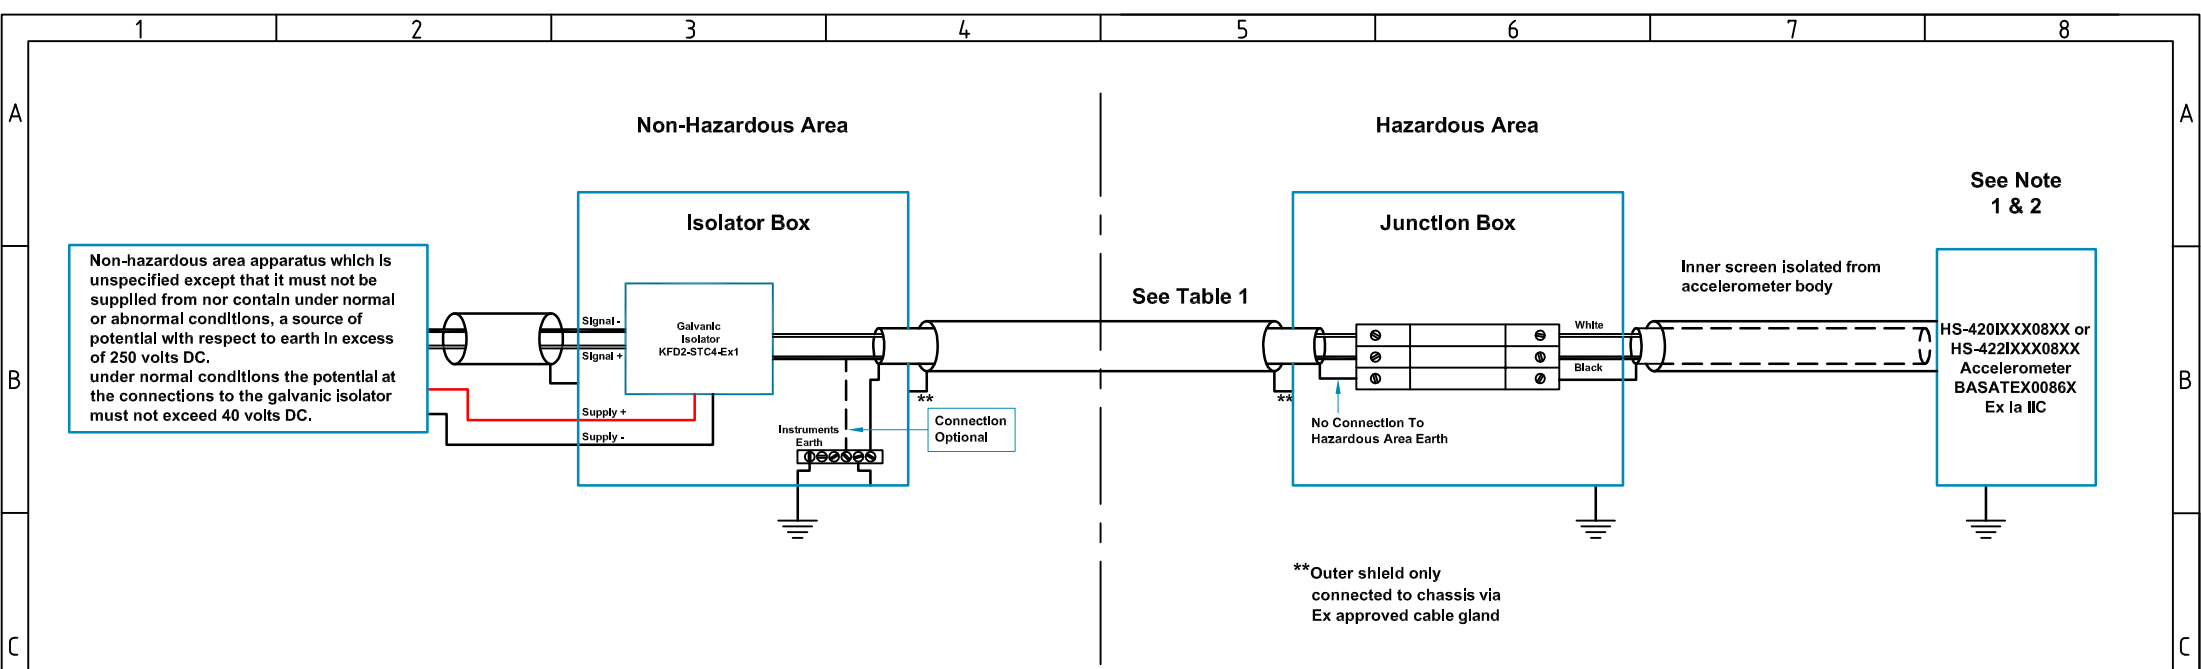


Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length ≤ 10m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585
Accelerometer With Integral Cable Length ≤ 50m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.091	72
IIB	0.762	277
IIA	2.592	585
Accelerometer With Integral Cable Length ≤ 100m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.083	72
IIB	0.754	277
IIA	2.584	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Notes:


1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By
A	Release	17/06/10	MJS	CMH

Material: N/A	
Tolerances Unless Stated	
0 or 0.0	±0.5
0.00	±0.15
Angle	±5°
Finish All Over Threads g6 H6	

**Hansford Sensors**
Excellence in Vibration Monitoring

Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE

 **Do Not Scale**

All Dimensions In mm Unless
Otherwise Stated

If In Doubt - Ask!

Description: System Connections
For HS-420I & HS-422I Group II
Accelerometers With Non Armoured
FR Polyurethane Cable
F.U.W. Galvanic Isolation

Drawing No: M06-033-A

Scale: NTS
Sheet: 1 of 1

Form Number:
QF024 Issue 1

HS-420I/M Intrinsically Safe Accelerometer



4-20mA velocity output via PUR Cable

Key Features

- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Waterproof and resistant to oil

Industries

Building services, Pulp and Paper, Mining, Metals, Utilities, Automotive, Water, Pharmaceutical

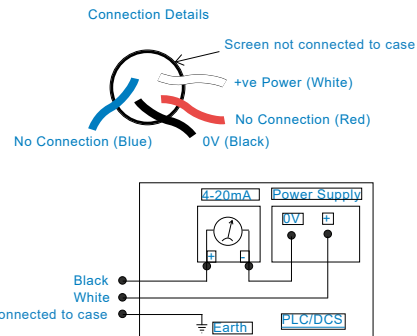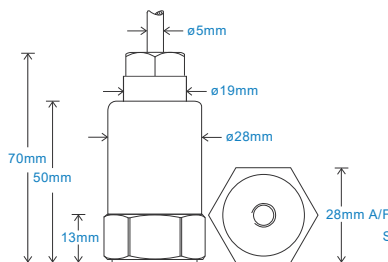

Technical Performance

Mounted Base Resonance	5kHz min
Velocity Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 1kHz (60kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Maximum Cable Length	1000 metres
Standard Cable Length	5 metres
Screened Cable	PUR - length to be specified with order
Mounting Threads	see: 'How To Order' table
Submersible Depth	100 metres max (10 bar)


Electrical

Current Output	4-20mA DC proportional to Velocity Range
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP68
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

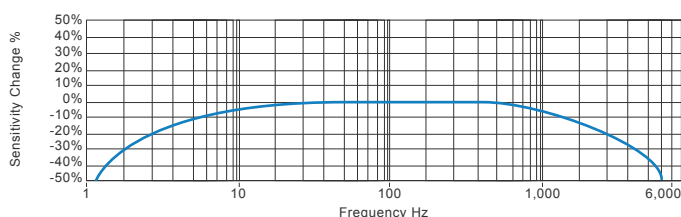

Applications

Fans, Motors, Pumps, Compressors, Centrifuges, Conveyors, Air Handlers, Gearboxes, Rolls, Dryers, Presses, Cooling, VAC, Spindles, Machine Tooling, Process Equipment

Vibration sensor should be firmly fixed to a flat surface (spot face surface may be needed to be produced and cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
 TS389.19




HS-420I/M Intrinsically Safe Accelerometer

4-20mA velocity output via PUR Cable

Intrinsically Safe Requirements

Maximum Cable Length	nominal 100 metres see attached system drawings	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231 Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C Zone 20, AEx, ia, IIC, T130°C, IP65, Da, -40°C to +110°C
Certificate details: Group I + II	IECEX BAS08.0034X Baseefa08ATEX0086X ⓂII 1GD Ex ia IIC T6 Ga Ex ia IIC T80°C IP65 Da Ⓜ I M1 Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)	Barrier	1 x Pepperl + Fuchs Galvanic Isolator KFD2-STC4-Ex1, which has superseded KFD2-CR-Ex1.30300 (BAS00ATEX7164) see attached system drawings
Certificate details: Group II	ⓂII 1GD Ex ia IIC T4 Ga Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C)		1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217) or Pepperl + Fuchs Zener Barrier Z787 (BAS01ATEX7005) or any other barrier that conforms to system drawings attached
Accelerometer System Certificate	Baseefa08Y0087 Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Zener Barrier	see attached system drawings
		System Connections for Galvanic Isolator	see attached system drawings
Terminal Parameters	Ui = 28V, Ii = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V Ii = 115mA Pi = 0.65W Group I	Terminal Parameters	Ui = Vmax = 28V Ii = Imax = 115mA Pi = 0.65W
500V Isolation	Units Will Pass A 500V Isolation Test	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Certified Temperature Range	Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)		
Australia Approval Group 1	IECEX ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval	Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

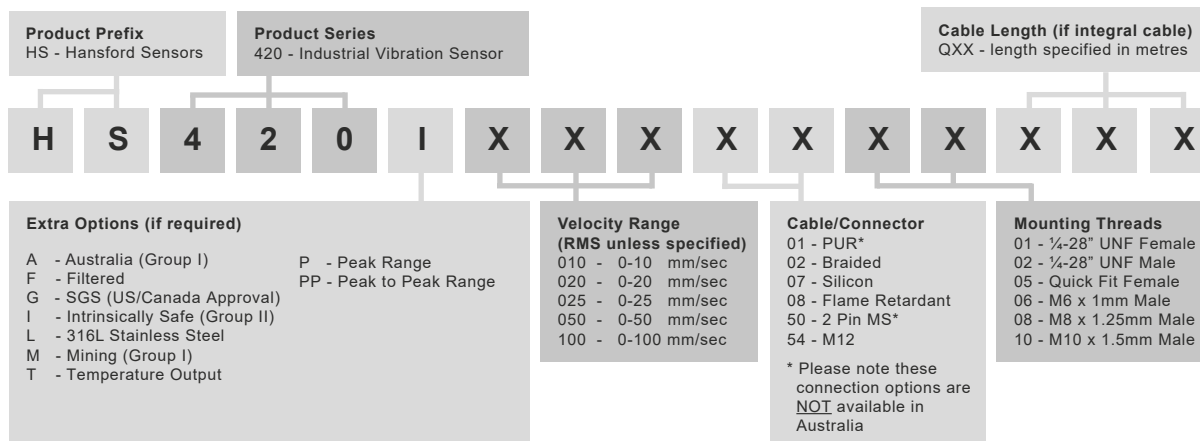






Table 1: Cable Parameters For Additional Cable Lengths		
Accelerometer With Integral Cable Length ≤ 10m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.097	72
IIB	0.768	277
IIA	2.598	585
Accelerometer With Integral Cable Length ≤ 50m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.091	72
IIB	0.762	277
IIA	2.592	585
Accelerometer With Integral Cable Length ≤ 100m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.083	72
IIB	0.754	277
IIA	2.584	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

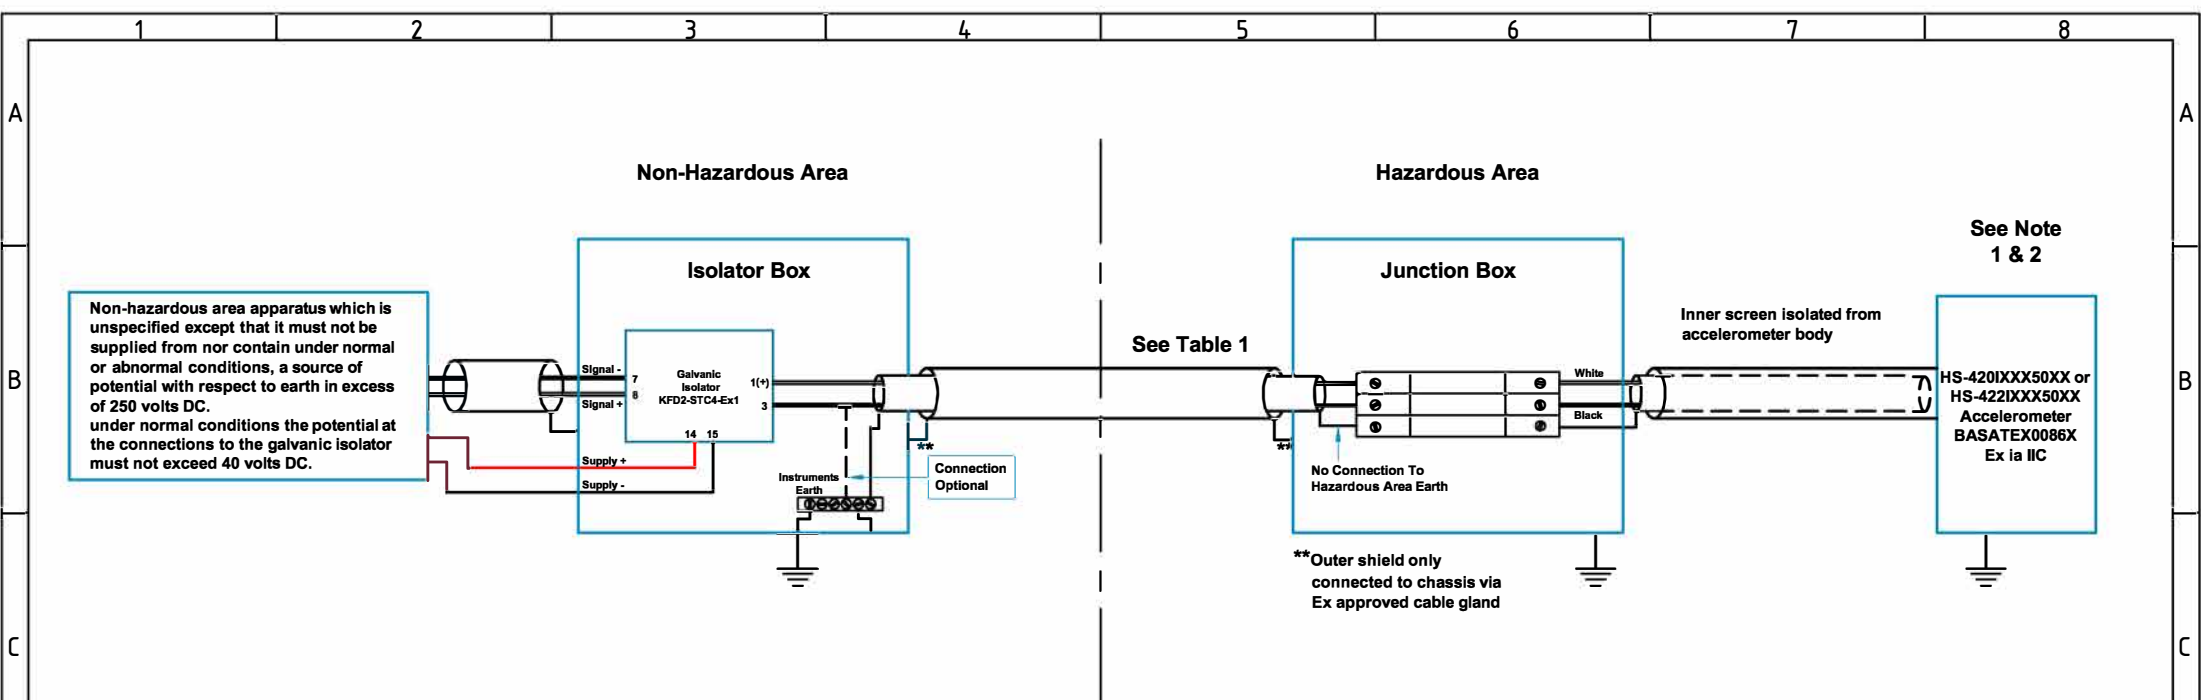- Notes:**
- The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
 - The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
 - The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	 Hansford Sensors Ltd Excellence in Vibration Monitoring Hansford Sensors Ltd Artisan, Hillbottom Rd Sands Industrial Estate High Wycombe Bucks. HP12 4HJ	 Do Not Scale	Description: System Connections Details For HS-420I & HS-422I Group II Accelerometers With PUR Cable F.U.W. Galvanic Isolation	
A	Release	16/09/15	MJS	CMH	Tolerances Unless Stated 0 or 0.0 ±0.5 0.00 ±0.15 Angle ±5° Finish All Over Threads g6 H6			Drawing No: M06-061-A	
						All Dimensions In mm Unless Otherwise Stated	If In Doubt - Ask!	Scale: NTS	Form Number: QF024 Issue 1
								Sheet: 1 of 1	

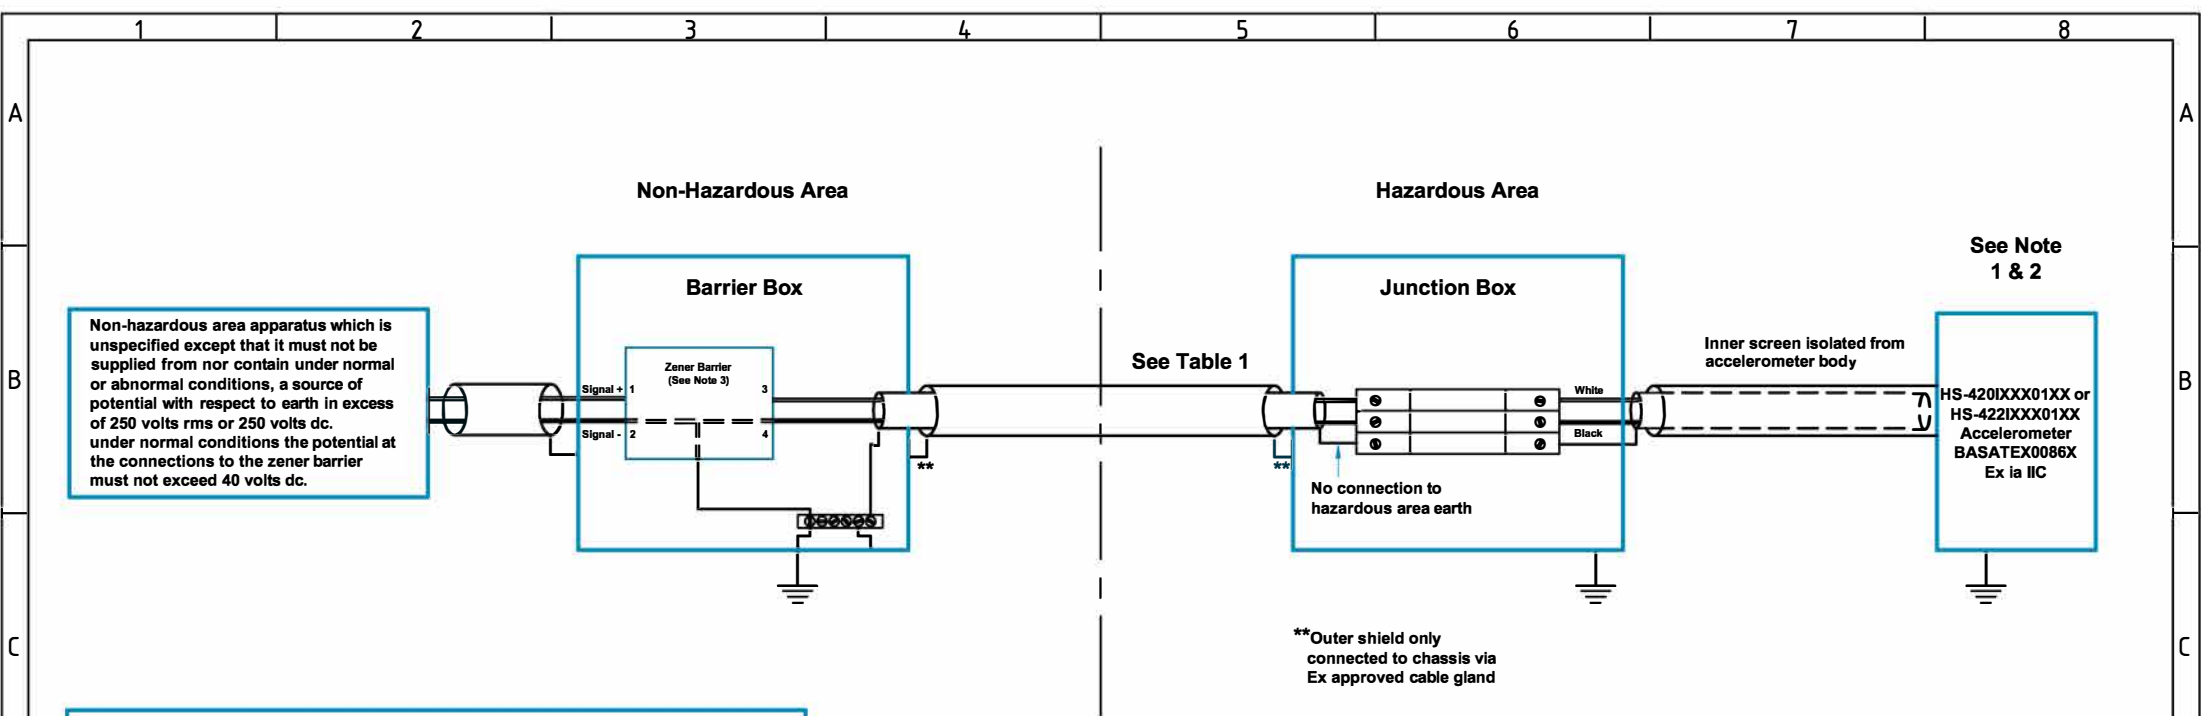


Table 1: Cable Parameters For Additional Cable Lengths



Accelerometer With Integral Cable Length ≤ 10m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.081	56
IIB	0.247	168
IIA	0.662	448
Accelerometer With Integral Cable Length ≤ 50m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.075	56
IIB	0.241	168
IIA	0.656	448
Accelerometer With Integral Cable Length ≤ 100m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.067	56
IIB	0.233	168
IIA	0.648	448

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System

Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

- Notes:**
1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
 2. The cable from the accelerometer to the junction box must not be installed in a high velocity dust laden atmosphere.
 3. Any shunt zener diode safety barrier certified by an ec approved body to [EEEx ia] IIC having the following output parameters: Uo = 28V dc, Io = 93mA dc, Po = 0.65W. e.g. MTL7787 to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005.
 4. The installer is to perform a risk assesment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	 Hansford Sensors Ltd Artisan, Hillbottom Rd Sands Industrial Estate High Wycombe Bucks. HP12 4HJ	 Do Not Scale	Description: System Connections For HS-420I & HS-422I Group II Accelerometers With PUR Cable F.U.W. Zener Barrier	
A	Release	16/09/15	MJS	CMH	Tolerances Unless Stated 0 or 0.0 ±0.5 0.00 ±0.15 Angle ±5° Finish All Over Threads g6 H6			Drawing No: M06-061-A	
						All Dimensions In mm Unless Otherwise Stated	If In Doubt - Ask!	Scale: NTS	Form Number:
								Sheet: 2 of 2	QF024 Issue 1

HS-420I/M Intrinsically Safe Accelerometer


4-20mA velocity output via Braided Cable

Key Features


- Intrinsically Safe with European, USA, Australian, South African, and Indian approvals
- Approved SIL 2 and SIL 3
- For use with PLC/DCS systems
- Customisable features

Industries

Building services, Pulp and Paper,
Mining, Metals, Utilities, Automotive,
Water, Pharmaceutical

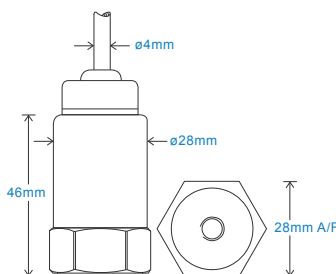

Connection Details

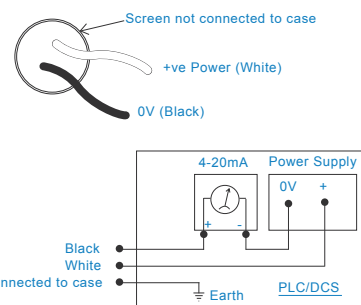

Technical Performance

Mounted Base Resonance	5kHz min
Velocity Ranges	see: 'How To Order' table $\pm 10\%$ Nominal 80Hz at 22°C
Frequency Response	10Hz (600cpm) to 1kHz (60kcpm) $\pm 5\%$ - ISO10816
Isolation	Base isolated
Range	50g peak
Transverse Sensitivity	Less than 5%

Mechanical

Case Material	Stainless Steel
Sensing Element/Construction	PZT/Compression
Mounting Torque	8Nm
Weight	150gms (nominal)
Maximum Cable Length	1000 metres
Standard Cable Length	5 metres
Screened Cable	Braided - length to be specified with order
Mounting Threads	see: 'How To Order' table


Electrical

Current Output	4-20mA DC proportional to Velocity Range
Supply Voltage	15-30 Volts DC (for 4-20mA)
Settling Time	2 seconds
Output Impedance	Loop Resistance 600 Ohms max. at 24 Volts
Case Isolation	$>10^8$ Ohms at 500 Volts

Environmental

Operating Temperature Range	see: attached certification details
Sealing	IP65
Maximum Shock	5000g
EMC	EN61326-1:2013


Typical Frequency Response

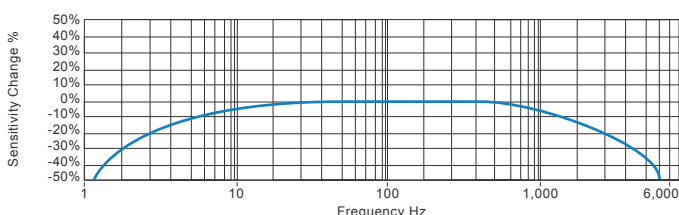

Applications

Fans, Motors, Pumps, Compressors,
Centrifuges, Conveyors, Air Handlers,
Gearboxes, Rolls, Dryers, Presses,
Cooling, VAC, Spindles, Machine Tooling,
Process Equipment

Vibration sensor should be firmly fixed to a flat surface
(spot face surface may be needed to be produced and
cable anchored to sensor body.)



Certifications



This product is certified in accordance with
UL 913, 8th Ed. Rev. December 6, 2013
CAN/CSA C22.2 No. 157-92 (R2012) +Upd1 +Upd2



www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice
TS061.22




HS-420I/M Intrinsically Safe Accelerometer

4-20mA velocity output via Braided Cable

Intrinsically Safe Requirements

Maximum Cable Length		nominal 100 metres	US/Canada Approvals	Certificate No. SGSNA/18/SUW/0000231
		see attached system drawings	Class I, II, III, Division 1, 2, Groups A - G, T4, -40°C to +110°C, Class I, Zone 0, AEx, ia, IIC, T4, Ga, -40°C to +110°C	
Certificate details: Group I + II		IECEX BAS08.0034X Baseefa08ATEX0086X	Zone 20, AEx, ia, IIIC, T130°C, IP65, Da, -40°C to +110°C	
		Ⓜ II 1GD	Barrier	1 x Pepperl + Fuchs Galvanic Isolator
		Ex ia IIC T6 Ga	KFD2-STC4-Ex1, which has superseded	
		Ex ia IIIC T80°C IP65 Da	KFD2-CR-Ex1.30300 (BAS00ATEX7164)	
		Ⓜ I M1	see attached system drawings	
		Ex ia I Ma		
		(-40°C ≤ Ta ≤ +60°C)	1 x MTL Zener Barrier MTL7787+ (BAS01ATEX7217)	
Certificate details: Group II		Ⓜ II 1GD	or Pepperl + Fuchs Zener Barrier	
		Ex ia IIC T4 Ga	Z787 (BAS01ATEX7005) or any other barrier that	
		Ex ia IIIC T130°C IP65 Da	conforms to system drawings attached	
		(-40°C ≤ Ta ≤ +110°C)		
Accelerometer System Certificate		Baseefa08Y0087	System Connections for Zener Barrier	see attached system drawings
		Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C) *On request - consult Sales Office	System Connections for Galvanic Isolator	see attached system drawings
Terminal Parameters		Ui = 28V, li = 115mA, Pi = 0.65W Group II Ui = 16.5V Pi = 0.65W or Ui = 28V li = 115mA Pi = 0.65W Group I	Terminal Parameters	Ui = Vmax = 28V li = Imax = 115mA Pi = 0.65W
500V Isolation		Units Will Pass A 500V Isolation Test	Notes:	Special conditions of safe use for Group II dust. The free end of the cable on the integral cable version of the apparatus must be terminated in an appropriately certified dust-proof enclosure. The unit has no serviceable parts.
Certified Temperature Range		Ex ia IIC T6 Ga (-40°C ≤ Ta ≤ +60°C) (Gas) Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +110°C) (Gas) Ex ia IIIC T80°C IP65 Da (-40°C ≤ Ta ≤ +60°C) (Dust) Ex ia IIIC T130°C IP65 Da (-40°C ≤ Ta ≤ +110°C) (Dust) Ex ia I Ma (-40°C ≤ Ta ≤ +60°C) (Mining)		
Australia Approval Group 1		IECEX ITA 10.0003X Ex ia I Ma (-40°C ≤ Ta ≤ +60°C)		
South African Approval		Certificate No. MASC MS/16-0229X Group I and II (As Baseefa/ATEX)		

How To Order

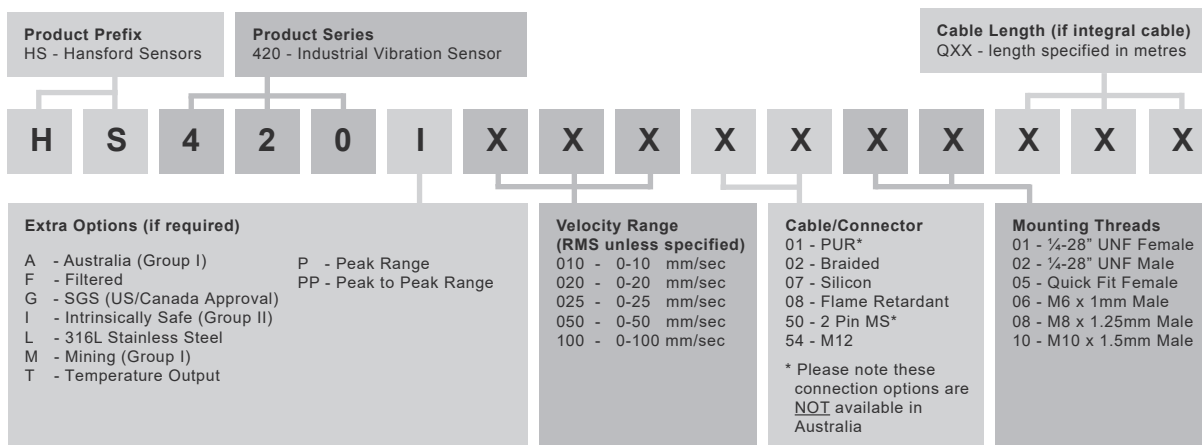

www.hansfordsensors.com
sales@hansfordsensors.com

We reserve the right to alter the specification of this product without prior notice

TS061.22









Table 1: Cable Parameters For Additional Cable Lengths		
Accelerometer With Integral Cable Length ≤ 10m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.096	72
IIB	0.767	277
IIA	2.597	585
Accelerometer With Integral Cable Length ≤ 50m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.084	72
IIB	0.755	277
IIA	2.585	585
Accelerometer With Integral Cable Length ≤ 100m		
Group	Capacitance µF	L/R Ratio µH/Ω
IIC	0.070	72
IIB	0.741	277
IIA	2.571	585

Hansford Sensors Ltd

HS-420I & HS-422I
Accelerometer System


Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

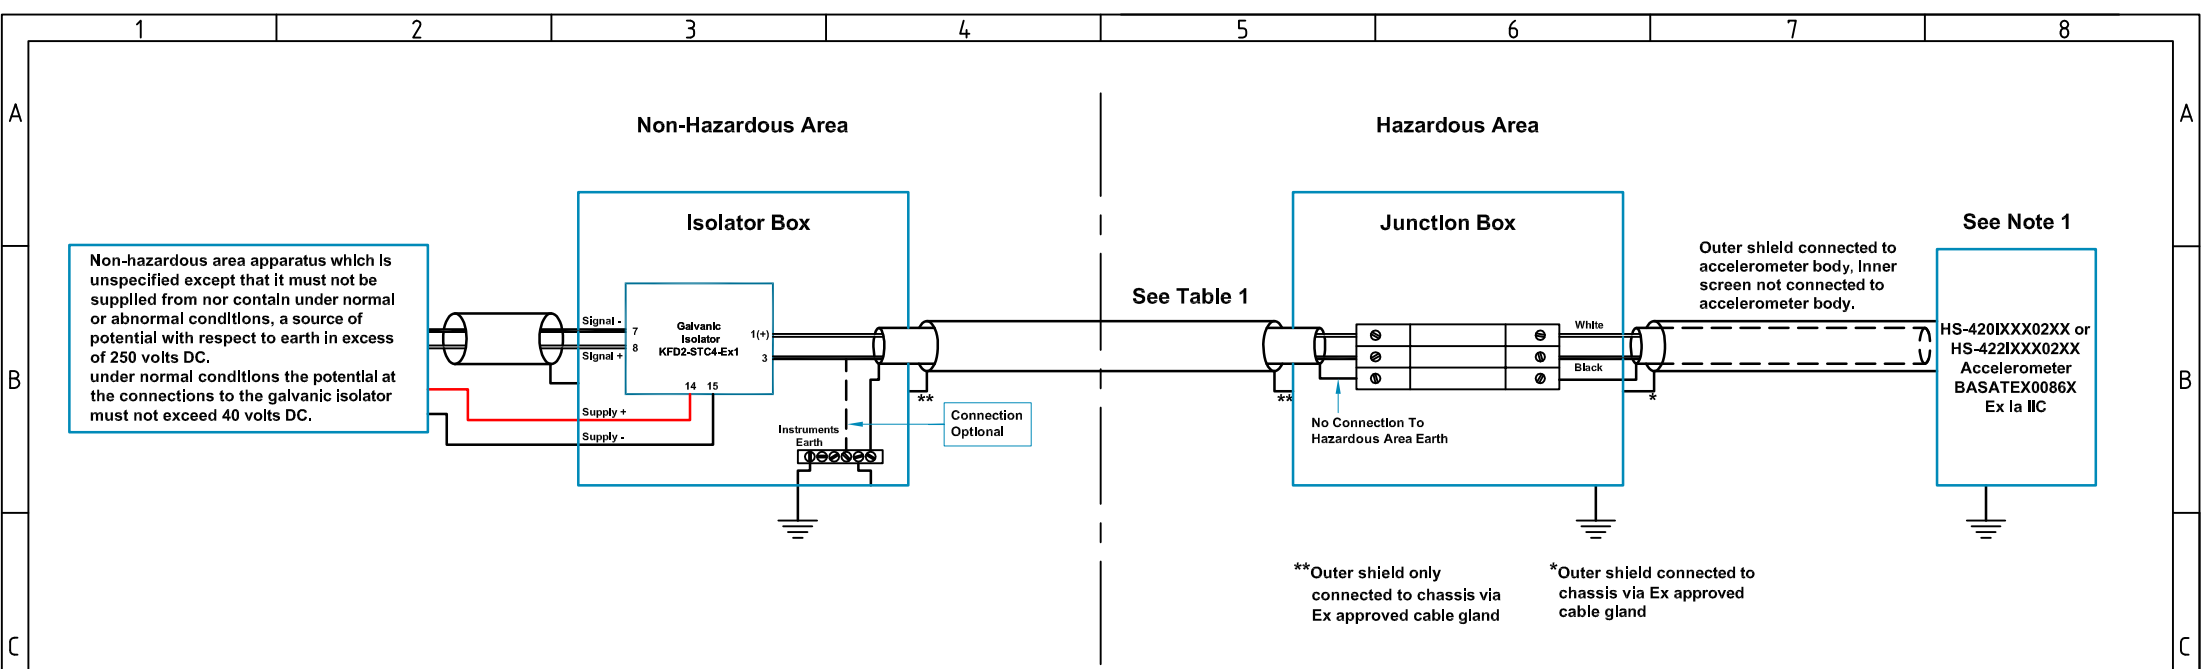- Notes:**
1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in table 1.
 2. The installer is to perform a risk assesment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A	 Hansford Sensors Ltd Saunderton Business Park Haw Lane Saunderton Bucks HP14 4JE	 Do Not Scale	Description: System Connections For HS-420I & HS-422I Group II Accelerometers With Armoured Cable F.U.W. Galvanic Isolation	
A	Release	17/06/10	MJS	CMH				Drawing No: M06-031-A	
					Tolerances Unless Stated		All Dimensions In mm Unless Otherwise Stated	Scale: NTS	Form Number: QF024 Issue 1
					0 or 0.0 ±0.5	 Finish All Over		Sheet: 1 of 2	
					0.00 ±0.15				
					Angle ±5°	Threads g6 H6			

Non-Hazardous Area

Hazardous Area

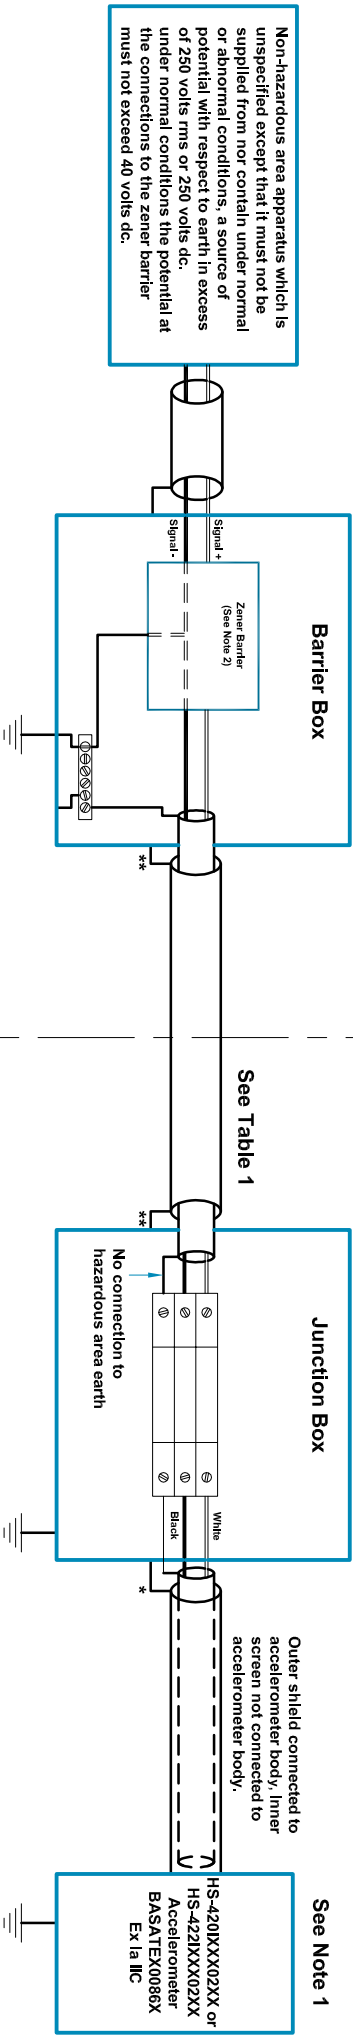

Non-hazardous area apparatus which is unspecified except that it must not be supplied from nor contain under normal or abnormal conditions, a source of potential with respect to earth in excess of 250 volts rms or 250 volts dc, under normal conditions the potential at the connections to the zener barrier must not exceed 40 volts dc.

See Table 1

See Note 1

HS-420XXXXX02XX or
HS-4221XXXX02XX
Accelerometer
BASATEX0086X
Ex ia IIC

baseefa 08

0 0 8 7



Hansford Sensors Ltd

HS-4201 & HS-4221
Accelerometer System
Baseefa08Y0087
Ex ia IIC T6 (-40°C ≤ Ta ≤ +60°C)

Table 1: Cable Parameters For Additional Cable Lengths

Accelerometer With Integral Cable Length ≤ 10m			
Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$	
IIC	0.080	56	
IIB	0.246	168	
IIA	0.661	448	
Accelerometer With Integral Cable Length ≤ 50m			
Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$	
IIC	0.068	56	
IIB	0.234	168	
IIA	0.649	448	
Accelerometer With Integral Cable Length ≤ 100m			
Group	Capacitance μF	L/R Ratio $\mu\text{H}/\Omega$	
IIC	0.054	56	
IIB	0.220	168	
IIA	0.635	448	

Notes:

1. The capacitance and inductance, or inductance - to - resistance ratio (L/R) of hazardous area cable, must not exceed the values shown in Table 1.
2. Any shunt zener diode safety barrier certified by an ec approved body to [EEx ia] IIC having the following output parameters: $U_o = 28\text{V dc}$, $I_o = 93\text{mA dc}$, $P_o = 0.65\text{W}$, e.g. MTL7787+ to BAS01ATEX7217 or Pepperl + Fuchs Z787 to BAS01ATEX7005
3. The installer is to perform a risk assessment in accordance with clause 10 of EN 60079-25 and install lightning protection arrestors as deemed necessary.

Rev No	DRF No	Date Drg	Drg By	Appd By	Material: N/A
--------	--------	----------	--------	---------	---------------

A	Release	10/03/08	MJS	CMH	
---	---------	----------	-----	-----	--

Tolerances Unless Stated

0 or 0.0 ± 0.5
0.00 ± 0.15
Angle $\pm 5^\circ$
Threads g6 H6



Hansford Sensors Ltd
Saunderton Business Park
Haw Lane
Saunderton
Bucks HP14 4JE



Do Not Scale

All Dimensions in mm Unless
Otherwise Stated

If In Doubt - Ask!

Description: System Connections
For HS-4201 & HS-4221 Group II
Accelerometers With Armoured Cable
F.U.W. Zener Barrier
Drawing No: M06-011-A

Scale: NTS
Sheet: 2 of 2
Form Number:
QF024 Issue 1